




LITTLE COMPTON ASSESSOR'S MAP (NOT TO SCALE)

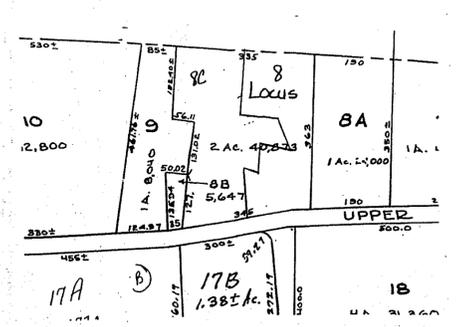


WESTPORT ASSESSOR'S MAP (NOT TO SCALE)

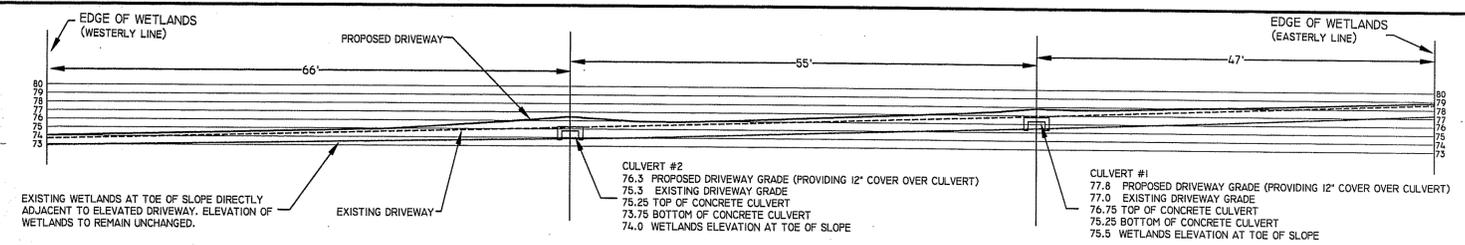





PROFILE OF DRIVEWAY IN WETLAND AREA

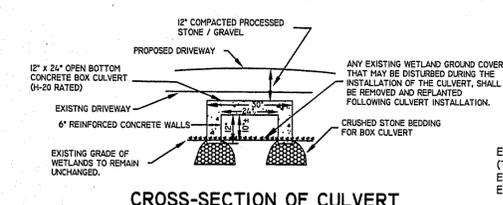


CROSS-SECTION OF CULVERT

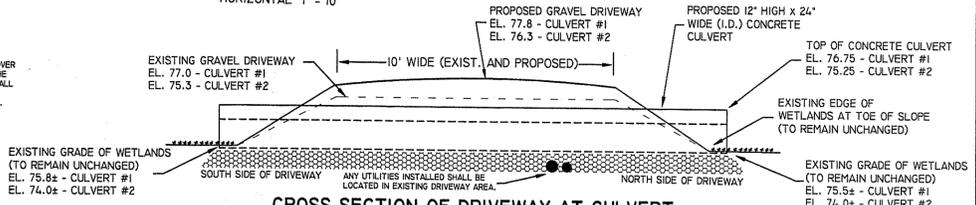

CROSS SECTION OF DRIVEWAY AT CULVERT

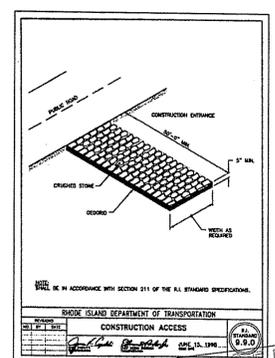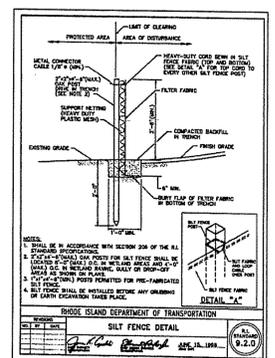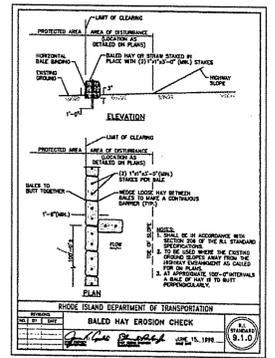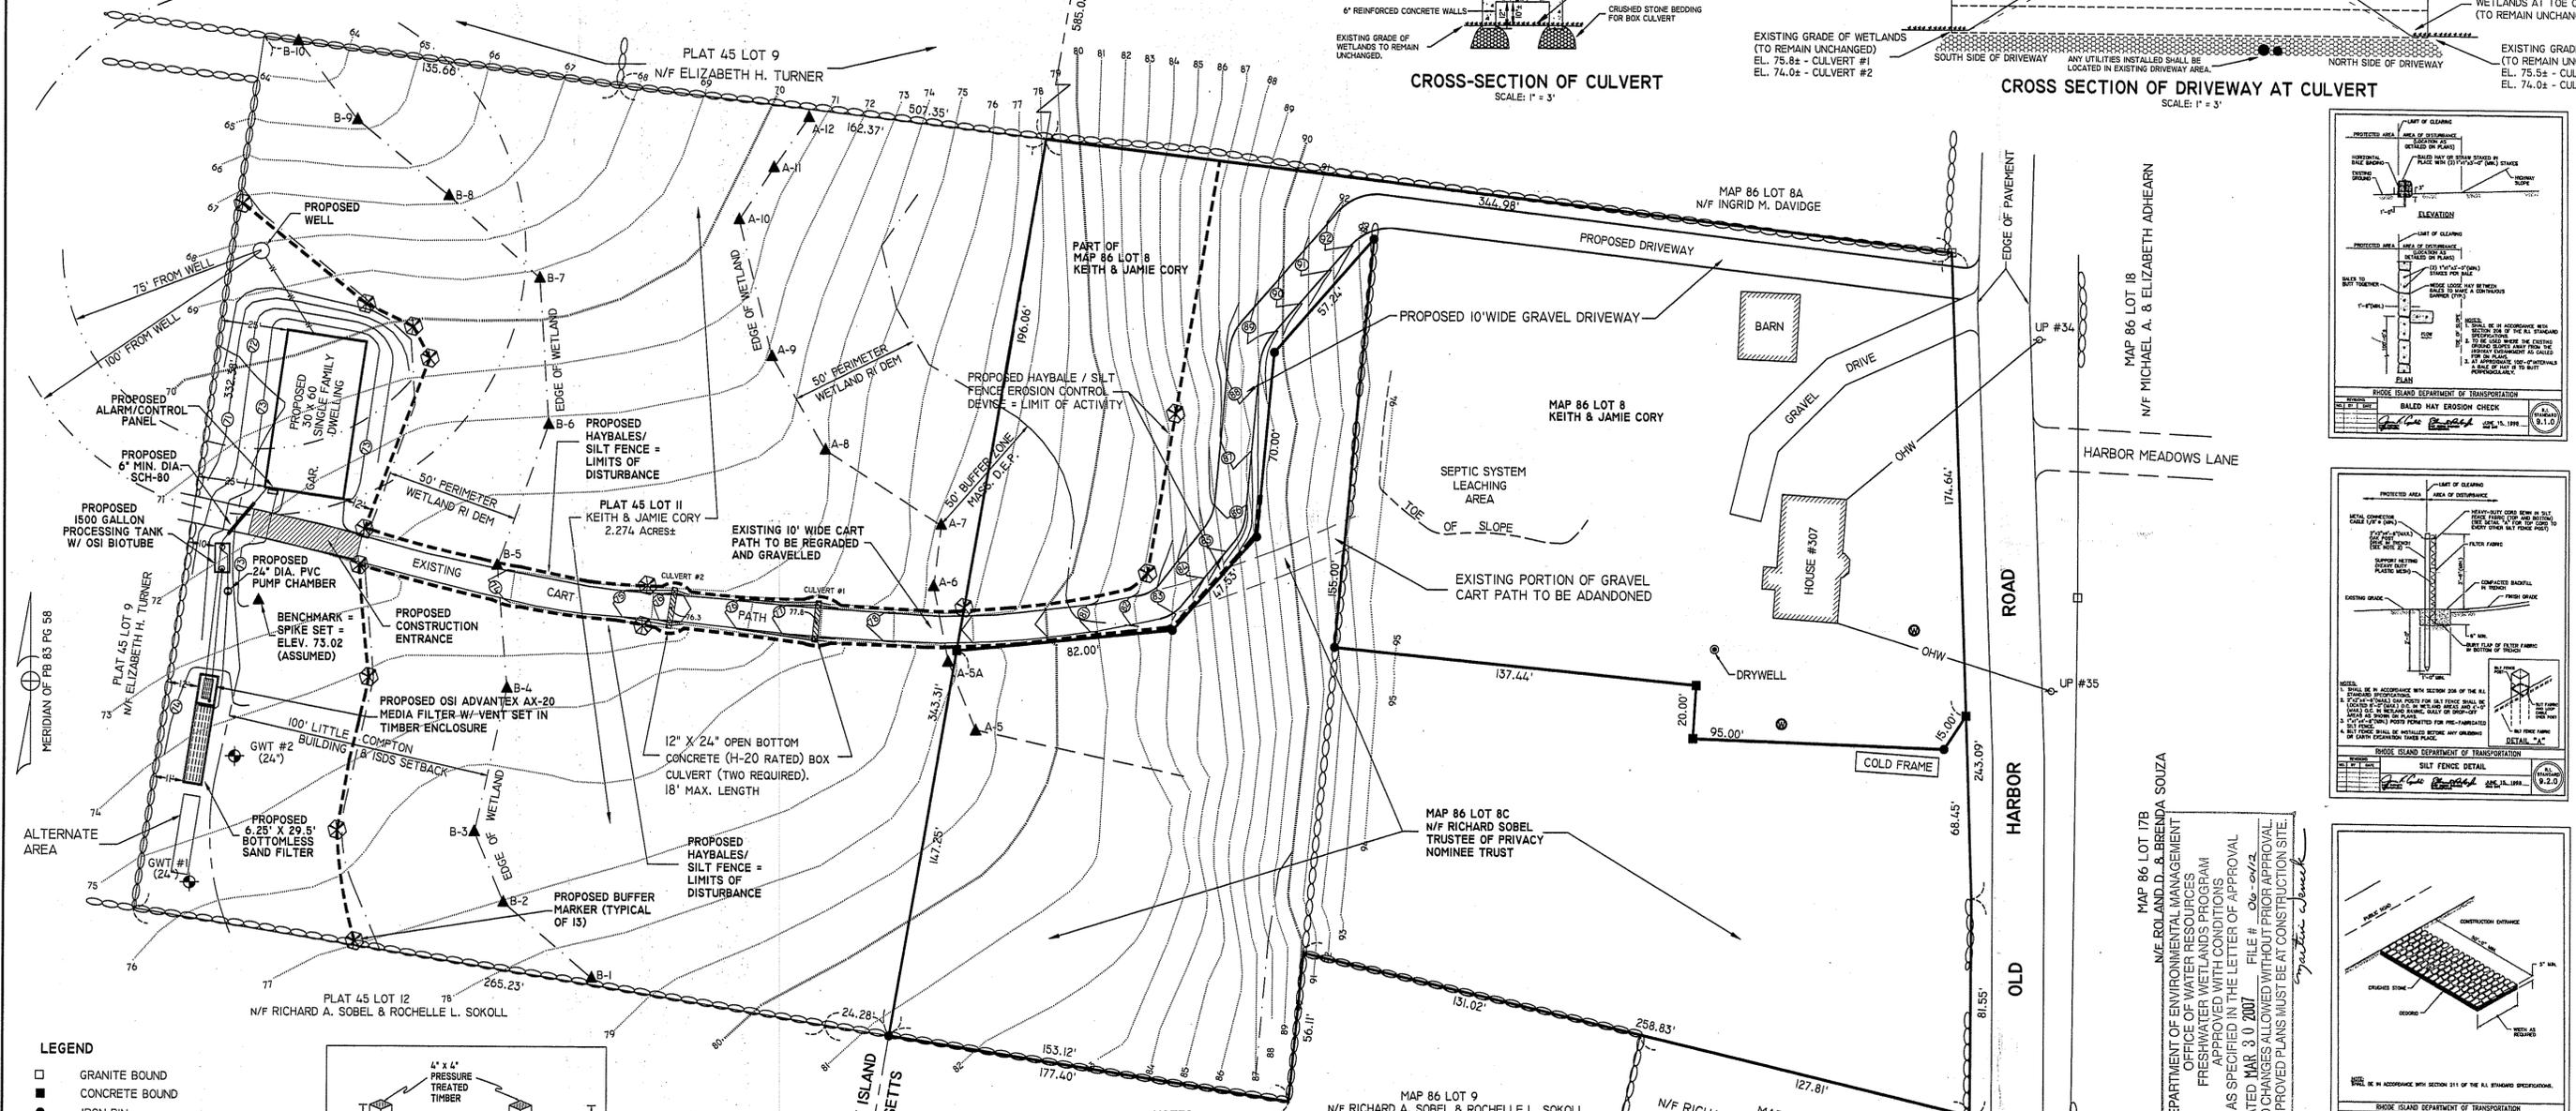


- LEGEND**
- GRANITE BOUND
  - CONCRETE BOUND
  - IRON PIN
  - UTILITY POLE
  - WELL
  - STONE WALL
  - N/F NOW OR FORMERLY
  - OHW OVERHEAD ELECTRIC AND/OR TELEPHONE WIRES
  - - - 50' PERIMETER WETLAND
  - - - 100' BUFFER ZONE (MA) OR BUILDING/ISDS SETBACK
  - ⊕ GROUND WATER TABLE
  - ⋯ EXISTING CONTOUR
  - ▲ WETLAND FLAG
  - ⊗ PROPOSED BUFFER MARKER

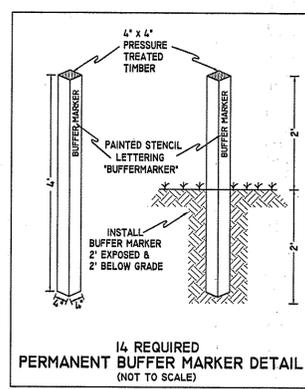

Kindly be advised that this Permit is not equivalent to a verification of the type or extent of freshwater wetlands on site.

1" = 30'

- NOTES:**
- 1) RECORD OWNER: KEITH & JAMIE CORY PO BOX 57 ADAMSVILLE, RI 02801
  - 2) ASSESSOR'S REFERENCE: WESTPORT ASSESSOR'S MAP 86 LOT 8 LITTLE COMPTON ASSESSOR'S PLAT 45 LOT II
  - 3) WETLAND EDGE DELINEATED BY NATURAL RESOURCE SERVICES, INC. MAY, 2005.
  - 4) PROPERTY LINES AS DEPICTED ON THIS PLAN ARE BASED ON AND CONFORM TO A CLASS I FIELD SURVEY STANDARD. TOPOGRAPHIC FEATURES AS DEPICTED ON THIS PLAN ARE BASED ON AND CONFORM TO A CLASS III SURVEY STANDARD.
  - 5) ANY UTILITY CONNECTIONS FROM THE PROPOSED DWELLING TO OLD HARBOR ROAD SHALL BE INSTALLED IN THE EXISTING DRIVEWAY PER UTILITY COMPANY SPECIFICATIONS.



1/4/07 PER DEM COMMENTS  
1) 10/30/06 PER DEM ISDS COMMENTS

SITE PLAN JAN 11 2007


WESTPORT, MASSACHUSETTS & LITTLE COMPTON, RHODE ISLAND

PREPARED FOR  
**KEITH & JAMIE CORY**  
307 OLD HARBOR ROAD


SCALE: 1" = 30' DATE: JUNE 7, 2006

**Civil Engineering Concepts, Inc.**  
34A MAIN STREET P.O. BOX 5323  
LITTLE COMPTON, RHODE ISLAND 02837 NEW BEDFORD, MA 02742  
(401) 592-0177 (508) 990-4900


SHEET 1 OF 2 JOB#: 05-019

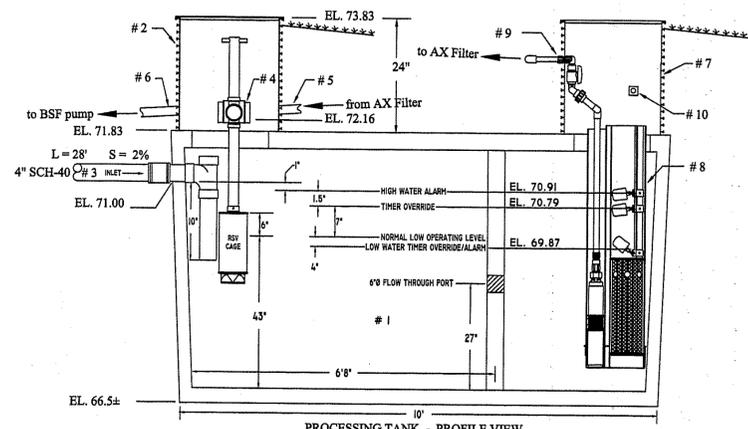

PROCESSING TANK - PROFILE VIEW

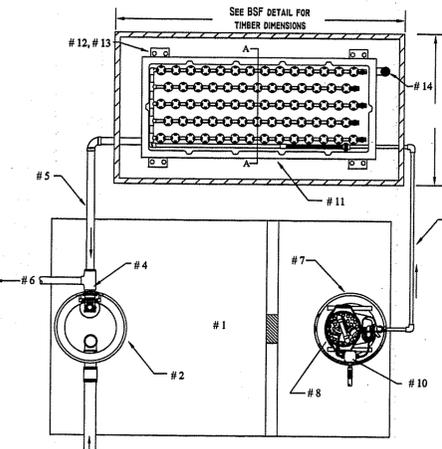


PROCESSING TANK / ADVANTEK FILTER PLAN VIEW

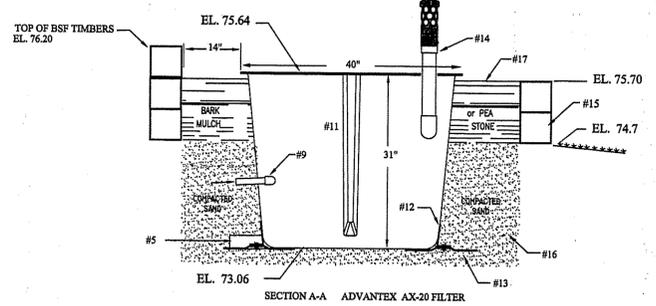

- 1500 gallon H-10 rated Processing Tank with baffle
- 24" high, 24" dia. PVC inlet riser / fiberglass cover, watertight tank adapter
- 4" SCH-40 PVC bldg. sewer inlet pipe w/ tee
- Recirc. Splitter Valve (manufacturer specified)
- 2" SCH-40 (gravity) pipe from AX-20 pod to R.S.V.
- 2" SCH-40 (gravity) pipe from R.S.V. to B.S.F. pump chamber
- 24" high, 24" dia. PVC riser / fiberglass cover, watertight tank adapter
- Biotube Recirc. Pump Package w/ OSI P3005, 1/2hp, 1" discharge
- 1" Class 200 (SCH-40) PVC from Biotube AX pump to AX pod. Pressure rated fittings required - DWV fittings not permitted
- Waterproof / Vapor-proof junction/splice box & elec. conduit
- Advantek AX-20 Recirc. Media Filter pod
- Factory installed bracket (1 of 4)
- Contractor installed, factory provided Anti-Floation Flanges (1 of 2) with stainless steel thru-bolts.
- OSI Passive Air Vent (ventilation assembly to extend 18" min. above adjacent finished grade)
- 6" x 6" P.T. Timber wall (same const. method as B.S.F. timber wall) Refer to Advantek AX general note #14 (right side of sheet).
- Compacted, well draining, granular (sandy) material. 5" minimum under pod.
17. Clean bark mulch (or pea stone) spread from top of sand up to 1" below top of AX pod.

**PROCESSING TANK - BUOYANCY CALCULATIONS**  
 Tank type: 1500 Gallon H-10 Tank Wt: 12,400 lbs.  
 Weight of Earth Cover (minimum of 1.5' of soil on tank): 6,825 lbs.  
 Upward lift (neglecting soil friction):  
 $10.5' (length) \times 5.66' (width) \times 3.6' (max. submerged depth) \times 62.4 \text{ lbs./cu. ft.} = 13,350 \text{ lbs.}$   
 Safety factor:  $\frac{12,400 + 6,825}{13,350} = 1.44$

PROCESSING TANK / ADVANTEK FILTER DETAILS  
NOT TO SCALE

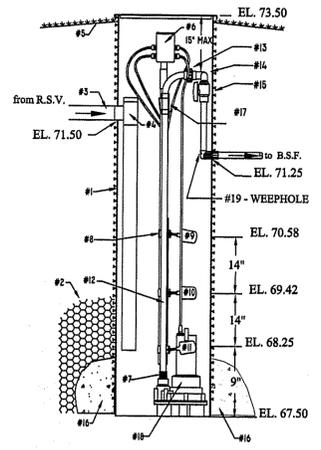

- 24" dia. PVC water tight basin w/ 24" fiberglass cover
- Backfill material to be compacted (1' lifts) granular (sandy) fill
- 2" SCH-40 PVC (gravity) from R.S.V. Pressure rated fittings required
- 2" x 2" x 2" SCH-40 tee with drop pipe extending to lowest float
- Finished grade to be 1" min. below cover
- Waterproof / vapor-proof PVC junction / splice box & elec. conduit (junction box, shut off, and disconnect shall be accessible from surface)
- SCH-40 reducer not required
- Level Control Float Assembly - removable w/o entry into chamber
- "ALARM" Float
- "ON" Float
- "OFF" Float
- Discharge piping: 1-1/2" Class 200 psi (SCH-40 w/ pressure rated fittings)
- Threaded Disconnect - accessible from surface w/o chamber entry
- Drainback-tee assembly required.
- Fully ported Shut-off
- CONCRETE BALLAST REQUIRED - 12 CU. FT. CU. FT. (min)
- Checkvalve not required. Anti-siphon valve not required.
- OSI # PEF33 Effluent Pump.
- 3/16ths inch Weephole (directed away from floats)

**B.S.F. PUMP CHAMBER - BUOYANCY CALCULATIONS**  
 Tank type: OSI 24" dia. PVC unit Tank Wt: 200 lbs.  
 Weight of Earth Cover: 0 lbs.  
 Concrete ballast: 12 cu. ft. x 87.6 lbs./cu. ft. = 1051 lbs. (submerged conc. weight)  
 Upward lift (neglecting soil friction):  
 Assume maximum water table at 1.5' below rim  
 $1.0' \times 1.0' \times 3.14 \times 4.5' \times 62.4 \text{ lbs./cu. ft.} = 882 \text{ lbs.}$   
 Safety factor:  $\frac{200 + 1051}{882} = 1.42$


B.S.F. PUMP CHAMBER DETAIL  
NOT TO SCALE

**NUMBER OF BEDROOMS: 3**  
**GARBAGE GRINDER: Not Allowed**  
**LEACHING SYSTEM USED: Bottomless Sand Filter**  
**SIZE OF PROCESSING TANK: 1500 gallons**  
**SECONDARY TREATMENT UNIT: Advantek AX-20 Recirc. Media Filter**  
**SOIL TYPE: Friable SIL**  
**APPLICATION RATE: Use Soil Category 8**  
**BSF LOADING RATE: 2.5 gal/sf/day, timed dose category -type system**  
**TOTAL SQ. FOOTAGE REQ'D: 450 GAL/DAY**  
 $\frac{450 \text{ GAL/DAY}}{2.5 \text{ L.R.}} = 180.0 \text{ S.F. REQ'D}$   
**BSF SQ. FOOTAGE PROVIDED: 625' x 29.5' = 184.3 S.F. PROVIDED**  
**BSF DOSING CYCLE: 14" drawdown "OFF" and "ON"**  
**DOSING QUANTITY: 27.4 GALLONS/CYCLE (equals emergency storage below high water alarm)**  
**BSF DISCHARGE: 27.4 gal/cycle - 4.1 gal (drainback)**  
 $\frac{38.2 \text{ gpm (pump discharge)}}{100 \text{ orifices}} = 0.233 \text{ GAL/ORIFICE CYCLE}$   
 $\frac{38.2 \text{ gpm (pump discharge)}}{100 \text{ orifices}} = 0.38 \text{ GPM/ORIFICE}$

**BASIS OF SANITARY DESIGN**

75.6+/-.....Finished First Floor	72.0 .....Average Exist. Grade at Processing Tank
74.5 .....Top of Foundation	70.00.....Elevation of Water-Table at Tank
70.5 .....Finished Crawl Space	71.00.....Inlet Invert at Processing Tank
71.50.....Invert at Building	
	71.50.....Inlet Invert at BSF Pump Chamber
	71.25.....Invert out of BSF Pump Chamber
	76.20.....Elevation of Top of Pea Stone
	75.76.....Invert at End of Distribution Lateral
	75.73.....Invert at Start of Distribution Lateral
	75.50.....Top of C-33 Filter Sand
	73.50.....Bottom of C-33 Filter Sand
	73.00.....Bottom of 6" layer C-33 / Native Soil
	72.5 .....Elev. of Water-Table at B.S.F.
	74.5 .....Existing Average Grade at B.S.F.
	75.2 .....Max. Prop. Grade Adjacent to BSF
	73.7 .....Min. Proposed Grade Adjacent to BSF

ELEVATION SCHEDULE

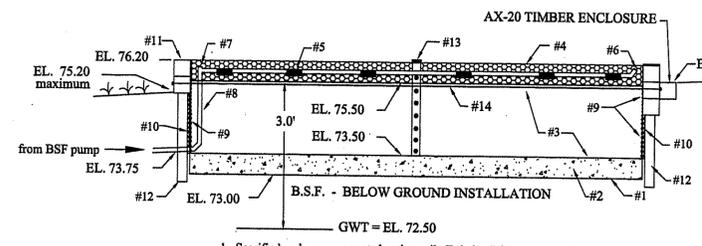


- Scarified and non-compacted native soil. Existing BSF ground surface preparation shall only consist of stripping native "A" and native "B" Horizons (if necessary) down to the specified elevation of the bottom of the sand / C-33 mix.
- 8" minimum thick layer of evenly mixed Native Mineral Soil (from A/B Horizon) and ASTM C-33 Sand
- 24" minimum thick layer of non-compacted ASTM C-33 Sand
- 8" (minimum) thick layer of 3/8ths inch Washed Pea Gravel
- 4" minimum pea stone layer required over top of piping / orifice shields
- Class 200 (SCH-40) PVC Laterals with pressure rated fittings and orifices (with shields) spaced and sized as specified in detail below.
- 90-degree sweep or 45-degree elbow with threaded female cap at end of Lateral.
- Class 200 (SCH-40) PVC Manifold sized as specified in detail below.
- Class 200 (SCH-40) PVC Transport pipe sized as specified in detail below. Insulation sleeved over vertical portion of transport pipe inside Biotube Manifold (allows cleaning access to Transport pipe).
- 30 mil. PVC liner
- 1/2" non-PT plywood support frame below grade
- 6" x 6" PT timber support frame above ground
- 4" x 4" vertical non-PT vertical support timbers to brace 6" x 6" timber frame construction and plywood frame. Recommend 3 vertical timbers at each corner and every 10' o.c.
- 4" dia. filter fabric wrapped SDR-35 inspection well with removable cap
- 1/2 inch (min) dia. threaded rods spaced as shown when 6" x 6" timbers exceed 2 courses in height or 15' in length. Refer to detail below and Bottomless Sand

**ABOVE GROUND INSTALLATION:** pinned 6" x 6" Pressure treated landscape timbers (arsenic & creosote-free) supported on 4" x 4" vertical non-PT supports. 30 mil. PVC liner inside Timbers.  
**TWO 1/2" THREADED TIE RODS EVENLY SPACED.**

**DISTRIBUTION LATERALS:** shall be 1.00" dia. Class 200 (SCH-40) PVC with 1/8 inch orifices drilled at 18" o.c. at 6 o'clock position with orifice shields. 1" dia. 45-degree elbows with threaded female caps at distal ends required. Laterals to slope back to Manifold.


Two orifices per lateral, one at 1/3rd and one at 2/3rds distance from manifold, shall be located at 12 o'clock position and fitted with orifice shield on top, to allow for proper drainback.

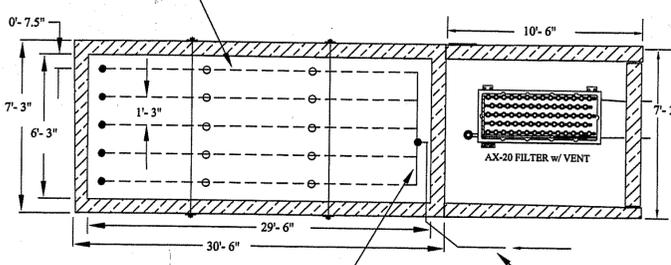

**MANIFOLD:** shall be 1.25" dia. Class 200 (SCH-40) pressure rated PVC pipe.

**TRANSPORT PIPE:** shall be 1.5" Class 200 (SCH-40) pressure rated PVC piping. Vertical section of pipe within the B.S.F. shall be insulated. Tee with threaded plug required at connection to Manifold to allow for future cleaning on Transport line.

BOTTOMLESS SAND FILTER DETAILS  
NOT TO SCALE




- Matching OSI Control / Alarm unit operating AX pump(s) and BSF pump.
- NEMA 4X (exterior) rated enclosure with lock
- Visual & Audible front-mounted alarms
- Programmable control panel w/ remote telemetry telephone connection, elapsed timer, dosing event counter.
- Mount on two 4" x 4" posts (or approved equiv.) to insulate building wall from any noise.

OSI CONTROL / ALARM PANEL DETAIL  
NOT TO SCALE

Kindly be advised that this Permit is not equivalent to a verification of the type or extent of freshwater wetlands on site.


DEPARTMENT OF ENVIRONMENTAL MANAGEMENT  
 OFFICE OF WATER RESOURCES  
 FRESHWATER WETLANDS PROGRAM  
 APPROVED WITH CONDITIONS  
 AS SPECIFIED IN THE LETTER OF APPROVAL  
 DATED MAR 30 2007 FILE # 06-0112  
 NO CHANGES ALLOWED WITHOUT PRIOR APPROVAL.  
 APPROVED PLANS MUST BE AT CONSTRUCTION SITE.



REVISIONS:	
2) 1/4/07 NO CHANGES THIS SHEET	
1) 10/30/06 NO CHANGES THIS SHEET	

**SITE PLAN**  
**WESTPORT, MASSACHUSETTS & LITTLE COMPTON, RHODE ISLAND**  
 PREPARED FOR  
**KEITH & JAMIE CORY**  
 307 OLD HARBOR ROAD  
 SCALE: NONE DATE: JUNE 7, 2006

**Civil Engineering Concepts, Inc.**  
 34A MAIN STREET P.O. BOX 5323  
 LITTLE COMPTON, RHODE ISLAND 02837 NEW BEDFORD, MA. 02742  
 PH: (401) 592-0177 FAX: (401) 592-0178  
 SHEET 2 OF 2 JOB#: 05-019



**GENERAL CONSTRUCTION NOTES:**

1. Designer recommends installing the system during dry months (June - October) to avoid complications with a high water table or excessive surface water runoff during construction. A HIGH WATER TABLE OR SATURATED GROUND CONDITIONS DURING CONSTRUCTION ACTIVITIES COULD COMPROMISE THE QUALITY AND LIFE EXPECTANCY OF THE SYSTEM.
- 1a. All construction shall conform to the State of Rhode Island and Providence Plantations Department of Environmental Management - Rules and Regulations Establishing Minimum Standards Relating to Location, Design, Construction, and Maintenance of Individual Sewage Disposal Systems as most recently amended, and in accordance with the Bottomless Sand Filter Construction Manual (as most recently amended).
2. All work shall be done in a workmanlike manner with lines laid as straight as possible and joints made watertight. All work shall be performed by an Installer licensed in the State of Rhode Island and certified for the installation of B.S.F. - type systems by RI DEM and the Vendor. Verification of installer's certification may be required by Designer prior to "start of construction" request by Installer.
3. DESIGNER TO BE NOTIFIED 72 HOURS PRIOR TO THE START OF ISDS CONSTRUCTION. CONTRACTOR IS TO ENSURE THAT DESIGNER IS NOTIFIED 2 WORKING DAYS IN ADVANCE OF ANY REQUIRED INSPECTIONS SO PROPER NOTIFICATION TO RI DEM CAN BE MADE.
4. Work shall not continue until the previous stage is inspected and approved. CONTRACTOR OR HOMEOWNER SHALL PROVIDE DESIGNER WITH A COPY OF THE RECORDED MAINTENANCE AGREEMENT prior to Designer's issuance of Certificate of Construction.
5. DIG-SAFE NOTIFICATION IS REQUIRED PRIOR TO ANY EXCAVATION. Any underground utilities shown are approximate only and are based on limited availability any local utility department as necessary. ACTUAL LOCATIONS ARE TO BE VERIFIED BY CONTRACTOR prior to excavation through Dig-Safe procedures and ARE TO BE UTILIZED FOR B.S.F. SHALL REMAIN CLEAR OF ALL VEHICLES, EQUIPMENT, AND STOCKPILED MATERIALS. The B.S.F. area shall be marked with caution tape to restrict access. Compaction or smearing of native soil will compromise the operation of the B.S.F.
7. PROPER SIZE HOLE SAWS, IN GOOD CONDITIONS, ARE TO BE USED FOR THE INSTALLATION OF CONDUIT/PIPING GROMMETS. Refer to, and follow, required hole sizes specified in manufacturer's installation documentation. The use of incorrectly sized hole saw will result in improperly seated grommets. Any conduit/piping installed into polyethylene riser or tank that is not watertight will NOT be approved by the Designer.

**SEPTIC/RECIRCULATION TANK:** Galonage as specified on Processing Tank Detail

1. Equipped with suitable cast-in-place PVC mounting flange for detailed diameter inlet & outlet PVC risers. Watertight bonding epoxy (or other proper adhesive) required between tank adapters and risers. ACCESS COVERS ARE NOT TO BE COVERED WITH SOIL. Final foam placement (elevation) shall be at least 1" below the access covers and graded away from tank.
2. ALL TANK SEAMS, riser connections (if any) and all plumbing joints are to be installed 100% watertight, sealed with suitable gasket material, or other bonding agent suitable for that specific component. Any knock-out holes in the bottom of the tank shall remain sealed or be sealed with suitable plug and hydraulic cement. Unused inlet/outlet knock-outs shall be sealed with hydraulic cement. Static water test required on tank following attachment of risers. The life span of the system would be compromised by the intrusion of any groundwater.
3. For proper operation, the septic tank shall be inspected annually and pumped out when any solids accumulation exceeds 1/3rd liquid depth.
4. Manufacturer's mounting hardware shall be utilized for Recirc. Splitter Valve installation and pump vault components. All materials and construction shall meet the manufacturer requirements and applicable plumbing, electrical, and safety codes. Third party or alternate generic parts requiring substantial field modifications to fit shall not be permitted.
5. Recirc. compartment Biotube Pump Vault shall be OSI Effluent Pumping System package specifically for discharging to the Advantek AX Filter (operating in Mode 3), and OSI control panel for operating a linked pump system (2 pumps in separate locations) unless otherwise specified on plan.
6. For additional PUMP INFORMATION, see details contained within this plan, accompanying documentation and manufacturers published information provided at the time of pump purchase. The information contained within this plan is intended to provide schematic requirements only. Actual manufacturer's shop drawings are to be coordinated with the component supplier, including all accessories such as alarms, floats, etc. that are compatible with the pumps. Old components requiring extensive modification to the system are not permitted.
7. A SIGN shall be posted in the vicinity of pump manholes warning of the potential of hazardous sewer gases and the need for proper confined space entry, venting, and air monitoring prior to work on the pump assembly.
8. ELECTRICAL WIRING is to be encased in suitable conduit with proper fittings at each end to maintain a watertight connection and prevent transport of vapors/gas from the components to the control panel and building. Electrical installation shall conform to all applicable local/state regulations.

**ADVANTEK AX RECIRCULATING MEDIA FILTER:**

9. THE AX POD SHALL BE LAID LEVEL ON A 5" (min) thick bed of compacted sand/gravel. When installed above the processing tank, it is recommended that a frame of non-P.T. 2" x 6" lumber be constructed on top of the processing tank to support the sand/gravel, preventing material washout from under the AX pod.
10. PROPER COMPACTION OF WELL-DRAINED GRANULAR MATERIAL under, along side, and above the four anti-floation flanges is necessary to ensure the pod will not float. If concrete ballast is specified on plan, compacted material under and along sides of the flanges is required to support the concrete.
11. HAND COMPACTION of backfilled material around the AX pod and related piping is required to prevent settlement and air pockets that may fill with water resulting in floatation.
12. All piping connected to the AX unit shall be Class 200 (SCH-40 or SDR-21) pressure rated piping with pressure rated fittings (no DWV-type fitting permitted).
13. The Passive Air Vent must be located less than 20' from the AX pod. 2" SCH-40 PVC connector pipe shall slope down from vent to pod to allow draining. Bottom of the perforated air intake shall be 12" minimum above finished grade.
14. Any specified courses of 6" x 6" P.T. timbers surrounding the pod shall be constructed the same as the B.S.F. timber frame. Compacted well-drained granular soil required below timbers. Timbers shall extend past the sides & ends of pod to allow for vent, plumbing, and flanges.
15. Mulch or pea stone covered with mulch shall be placed between the pod and the timbers, extending to the top of the timbers.
16. Finished grade shall slope down and away from all exposed covers to prevent surface water from flooding and ponding along sides of the pod and tank.

**B.S.F. PUMP SYSTEM:**

17. OSI # 6" deep PVC secondary pump chamber. Any weepholes shown shall not be directed toward floats. Pump floats shall be controlled by the septic/recirculation tank Biotube Pump Vault Control Panel. Discharge piping shall be equipped with an anti-siphon valve only when B.S.F. is located below the pump chamber "OFF" float elevation. Final foam placement (elevation) shall be at least 1" below the fiberglass/PVC access cover and graded away from chamber.
18. TRANSPORT LINE shall be Class 200 (SCH-40) pressure rated PVC pipe with pressure rated fittings laid at consistent slope up to the B.S.F. allowing drainback, unless entire transport pipe is discharge pipe. 1 cu. ft. (min) concrete thrust blocks required at all angle points.
19. B.S.F. PUMP(S) shall be as specified, with indicated discharge diameter, for pressurizing the B.S.F. Any pump substitution shall require the Designer's review of the substitute pump specifications and pump curve.
20. B.S.F. PUMP CALCULATIONS input data/pump curve is provided on attachment with application. Lateral lengths & manifold lengths used for pump specifications reflect that piping does not extend to the far edges of the B.S.F. filter box.

**ELECTRICAL CONTROL / ALARM PANEL:** w/ telephone line remote telemetry connection

21. CONTROL PANEL shall be an OSI pump-matched NEMA-4 rated waterproof lockable unit with visual alarms and programmable timer that operates both OSI AX Media Filter pump unit and B.S.F. pump ON SAME CIRCUIT. Panel to be mounted adjacent to EXTERIOR WALL of the building within view of the tanks. Outside face of panel shall be equipped with high-intensity alarm light and alarm silence button that shall automatically reactivate after 12 hours.
22. A START UP TEST is required to be performed by the installer / maintenance provider and witnessed by Designer of the AX pumping system, the B.S.F. pumping system, and pressure (head) testing of the B.S.F. laterals. Any subsequent electrical work shall include the Electrician's verification that the electricity is properly restored to the Control Panel.

**BOTTOMLESS SAND FILTER (B.S.F.):**

23. B.S.F. shall be constructed as shown with materials as specified in the details. Installation of a 4" dia. perforated (filter fabric wrapped) inspection well required.
24. Sand media material shall conform to ASTM C33 sand (sieve) requirements with less than 1% fines passing number 200 sieve. Bank run sand or conventional ISDS sand/gravel is not permitted. DESIGNER MAY REQUIRE SIEVE ANALYSIS FROM SAND SUPPLIER WITHIN 4 DAYS PRIOR TO SAND DELIVERY.
25. MANIFOLD: Dia. as specified on detail and shall be Class 200 (SCH-40) PVC. All fittings shall be pressure rated (DWV fittings not recommended).
26. DISTRIBUTION LATERAL: Dia. specified on detail and shall be Class 200 (SCH-40) PVC with 1/8" orifice holes (drilled with new bit) and fitted slotted cold weather orifice shields cap. Sweep elbows extending to the surface are not to be installed on ends. All fittings shall be pressure rated (DWV fittings not acceptable).
27. LEACHING AREA EXCAVATION shall be level and scarified as shown on B.S.F. cross-section detail. Care shall be taken to avoid compaction of remaining soil. Excavation of grass / thatch layer and A horizon. PREPARED NATIVE SOIL SURFACE (BOTTOM INSPECTION) SHALL BE INSPECTED BY DESIGNER PRIOR TO PLACEMENT OF 6" THICK LAYER OF SAND/SOIL MIX.
28. ABOVE GROUND B.S.F. SUPPORT FRAMING shall consist of 6" x 6" pressure treated timbers drilled and pinned to the soil with #3 or #4 rebar and screwed/nailed together at the corners and joints. BELOW GROUND CONSTRUCTION shall utilize 1/2" min. thickness P.T. plywood in place of timbers. 30 mil. liner shall be placed inside timbers and plywood.
29. Where more than two courses of 6" x 6" timbers are exposed, 1/2" dia. THREADED GALVANIZED ROD(S) with 2" dia. galvanized washers and nuts shall be installed in the second timber down from the top (to support timbers from bowing out), evenly spaced along the length of B.S.F. (approximately 12' o.c.).
30. TREES OR SHRUBS shall not be planted within 10' of the B.S.F. without vertical placement of a suitable root barrier fabric installed at least 3' beyond the B.S.F. and extending from 4' below finished grade to 1' below the bottom of the native soil/B.S.F. sand interface.
31. HEAVY EQUIPMENT shall not be operated over the components or the prepared leaching area during installation. RUBBER Tired MACHINERY is NOT to be driven over the corners and joints. BELOW GROUND CONSTRUCTION shall utilize 1/2" min. thickness P.T. plywood in place of timbers. 30 mil. liner shall be placed inside timbers and plywood.
32. B.S.F. IS NOT TO BE COVERED (if any) WELLS within 200' of proposed ISDS are shown.
33. ALL EXISTING OR PROPOSED SEPTIC SYSTEMS within 50' of proposed ISDS are shown.
34. ALL EXISTING OR PROPOSED (if any) PUBLIC WELLS within 50' of proposed ISDS are shown.
35. NO PARKING is permitted in the vicinity of the ISDS.
36. NO DRAINS ALLOWED within 25' of proposed ISDS.
37. A BACKUP GENERATOR (adequate for supplying the pumps in case of electrical failure) is strongly recommended.
38. PROPERTY LINES as depicted on this plan are approximate only based on Assessor Tax Maps and are not the result of a boundary survey.

40. A MANUFACTURER-APPROVED MAINTENANCE CONTRACT for the pump/filter systems is required to be filed in the applicable Town Hall Land Evidence records office. Contract must be kept current as a condition of approval.

41. ANY SILT FENCING OR HAYBALE CHECKDAMS shown on the plan are to be installed prior to any site activity and shall remain in place and be maintained until all activities are completed, inspections performed, and vegetation established.
42. ANY SUBSTANTIAL SILT ACCUMULATION against the haybales or silt fencing is to be removed in a manner that will not compromise the effectiveness of the erosion control device.
43. ALL CONSTRUCTION LITTER AND DEBRIS is to be removed from the vicinity of the haybales or silt fencing on a daily basis.