

SYMBOL	PLANT SPECIES	# of PLANTS
A	SWEET PEPPER BUSH	(3)
B	JOE PYE WEED	(1)
C	SWEET FERN	(2)
D	HIGHBUSH BLUEBERRY	(3)
E	BUTTERFLY MILKWEED	(5)
F	BLUE FLAG IRIS	(12)
G	BEARBERRY	(15) FILL IN





NOTE: PLANTS MUST BE INCLUDED ON RI COASTAL PLANT LIST AS ACCEPTABLE FOR RAIN GARDENS. SUBSTITUTIONS WILL BE PERMITTED WITH CONCURRENCE FROM RI CRMC.

PROPOSED IMPERVIOUS COVERAGE:
1200 SF PROPOSED IMPERVIOUS BUILDING AREA INCREASE
1200 SF TOTAL INCREASE IN IMPERVIOUS AREA


PER RI STORMWATER MANAGEMENT GUIDELINES FOR INDIVIDUAL SINGLE FAMILY RESIDENTIAL LOT DEVELOPMENT, TABLES 7 AND 8, RAIN GARDEN SIZING

SF OF RAIN GARDEN NEEDED = 1200 SF OF IMP. AREA x (100 SF OF RAIN GARDEN / 100 SF IMP. AREA) = 120 SF OF RAIN GARDEN AREA

DRAINAGE AREA REQUIRED FOR 8\"/>

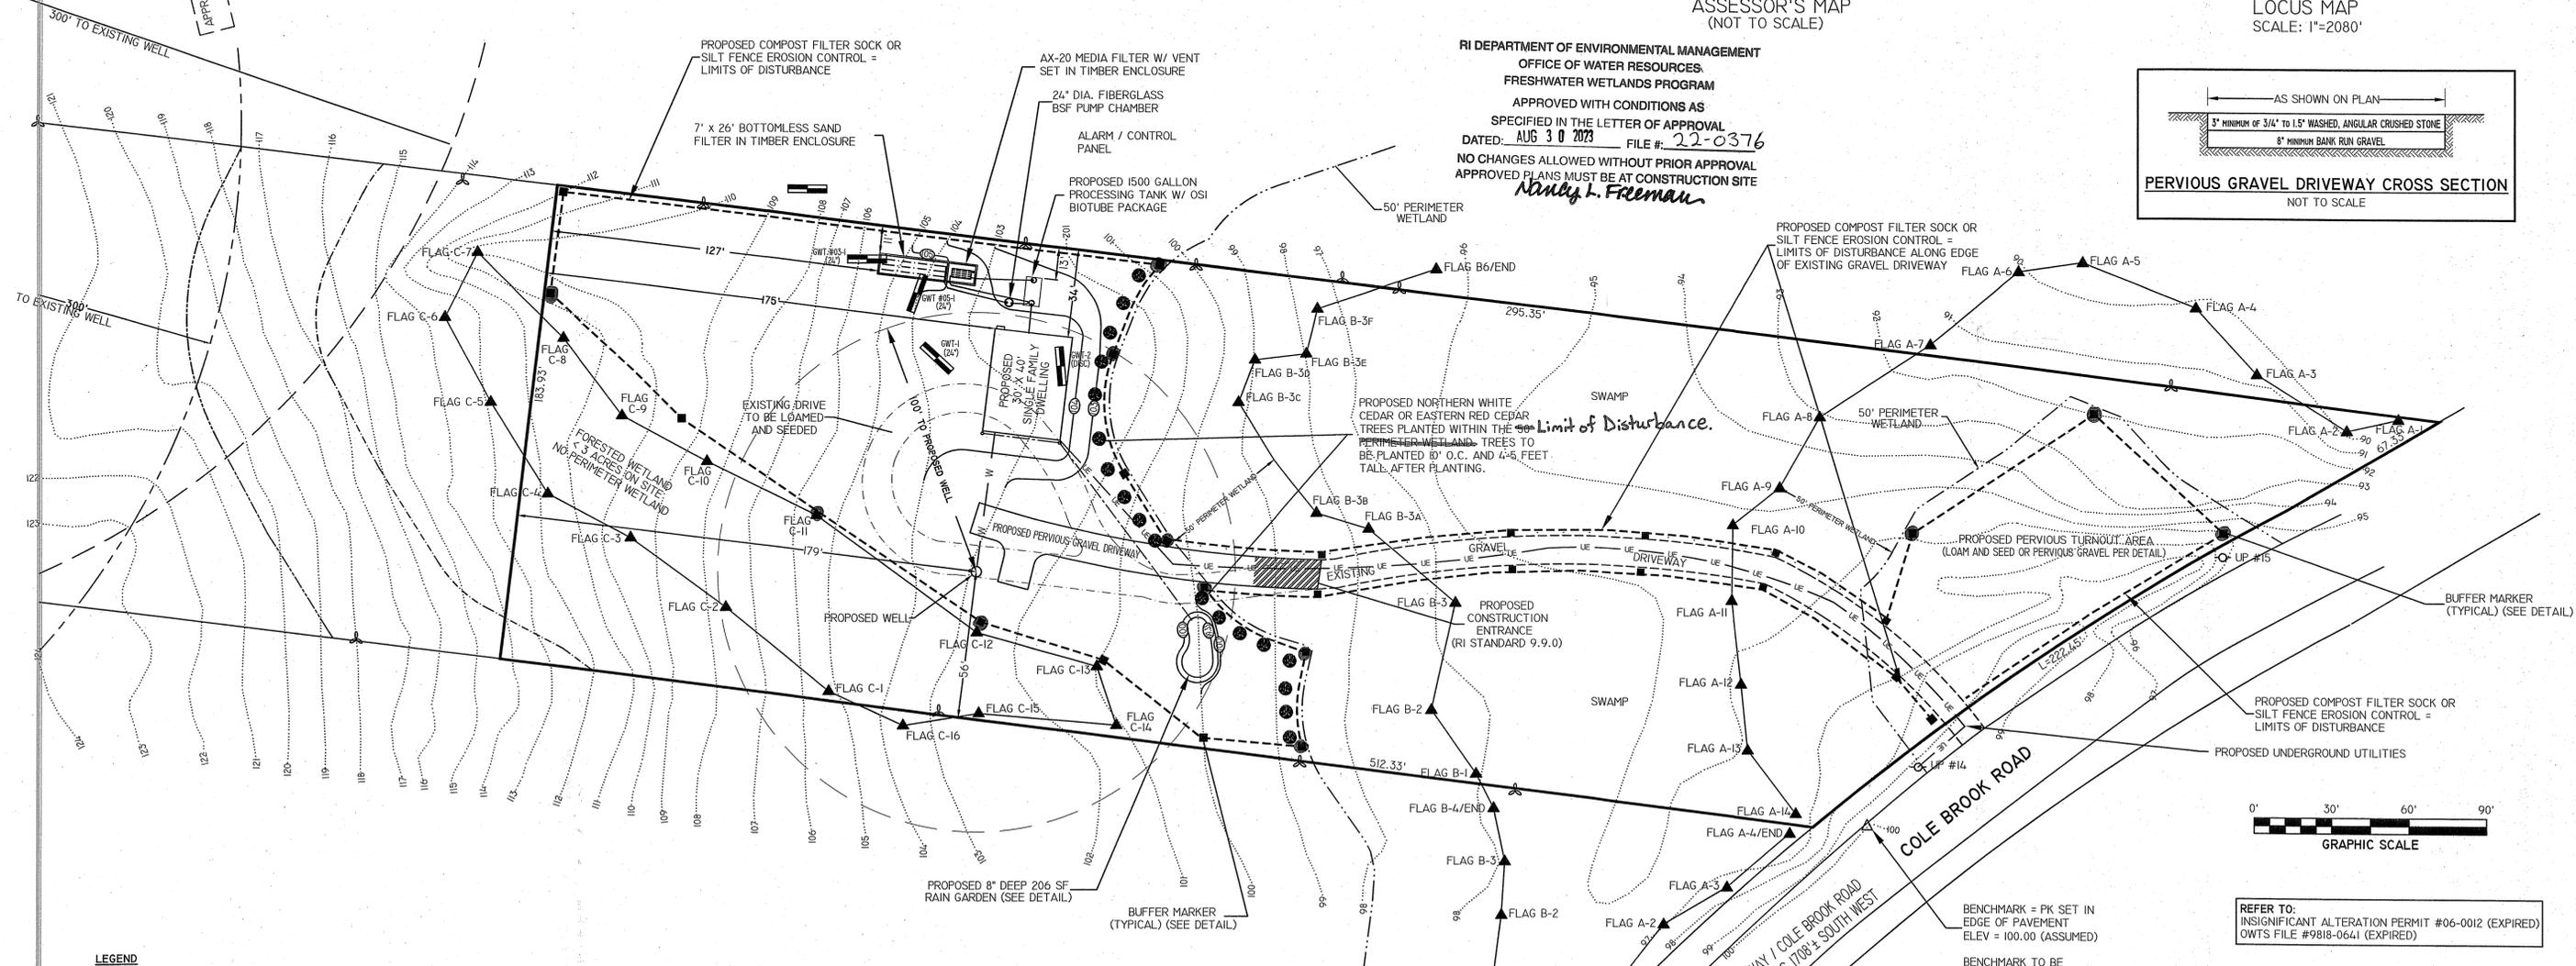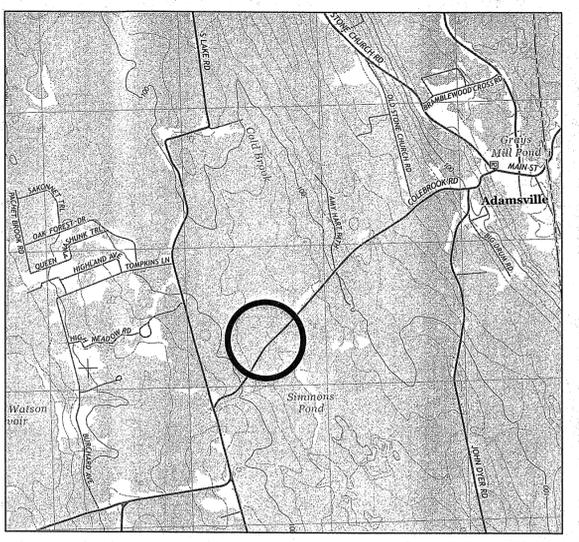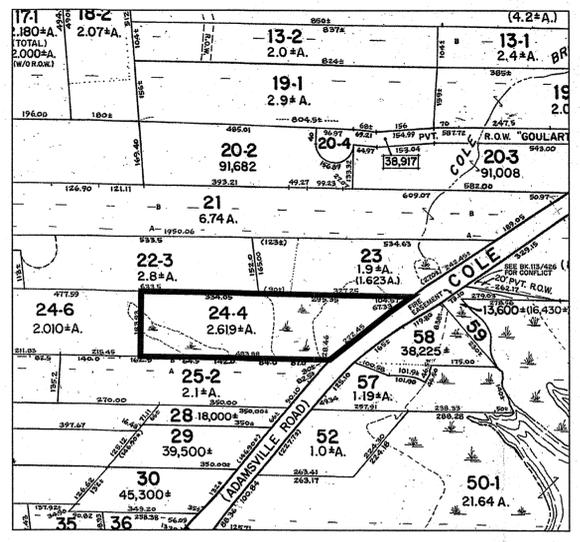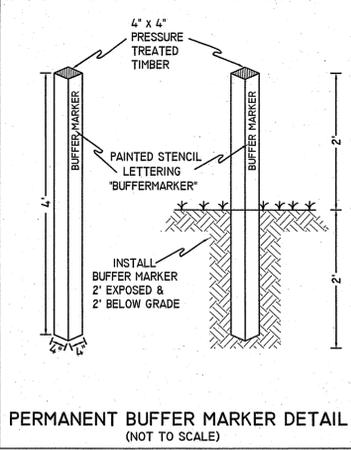

RI DEPARTMENT OF ENVIRONMENTAL MANAGEMENT
OFFICE OF WATER RESOURCES
FRESHWATER WETLANDS PROGRAM
APPROVED WITH CONDITIONS AS SPECIFIED IN THE LETTER OF APPROVAL DATED: AUG 30 2023 FILE #: 22-0376
NO CHANGES ALLOWED WITHOUT PRIOR APPROVAL APPROVED PLANS MUST BE AT CONSTRUCTION SITE
Nancy L. Freeman

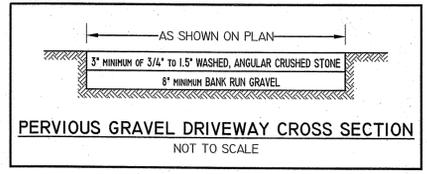


- LEGEND**
- EXISTING CONTOUR
 - STONE PILE
 - UTILITY POLE
 - SOIL EVALUATION TEST PIT
 - DELINEATED WETLAND EDGE
 - 50' PERIMETER WETLAND
 - EXISTING EDGE OF GRAVEL DRIVEWAY
 - GRAVEL DRIVEWAY TO BE REMOVED
 - PROPOSED CONTOUR
 - PROPOSED PERMANENT BUFFER MARKER
 - PROPOSED COMPOST FILTER SOCK OR SILT FENCE EROSION CONTROL = LIMIT OF DISTURBANCE
 - PROPOSED ROOF DOWNSPOUT COLLECTION SYSTEM
 - PROPOSED UNDERGROUND ELECTRIC SERVICE

RI DEPARTMENT OF ENVIRONMENTAL MANAGEMENT
OFFICE OF WATER RESOURCES
FRESHWATER WETLANDS PROGRAM

NOTE PER DEM:
Kindly be advised that this Permit is not equivalent to a verification of the type or extent of freshwater wetlands on site

- NOTES:**
- ALL WORK SHALL COMPLY WITH THE ISSUED RIDEM PERMIT. A COPY OF THE RIDEM PERMIT AND APPROVED PLAN SHALL BE KEPT ON-SITE FOR THE DURATION OF THE PROJECT.
 - NO FUELING OF VEHICLES IS PERMITTED WITHIN 100 FEET OF THE WETLAND FEATURE.
 - COMPOST FILTER SOCK OR SILT FENCE EROSION CONTROL SHALL BE INSTALLED PRIOR TO THE START OF CONSTRUCTION ACTIVITIES AND REMAIN IN PLACE UNTIL COMPLETION AND OF THE PROJECT AND GRASS IS RE-ESTABLISHED IN DISTURBED AREAS. COMPOST FILTER SOCK OR SILT FENCE SHALL BE INSPECTED DAILY AND REPLACED OR MAINTAINED AS NECESSARY.
 - THE SITE SHALL BE POLICED DAILY FOR TRASH AND CONSTRUCTION DEBRIS. ALL SUCH MATERIALS SHALL BE DISPOSED OF IN THE PROPER RECEPTACLES.
 - IT IS THE CONTRACTORS RESPONSIBILITY TO NOTIFY DIG SAFE AS REQUIRED BY LAW PRIOR TO THE START OF CONSTRUCTION ACTIVITIES. UTILITIES DEPICTED ON THIS PLAN ARE APPROXIMATE ONLY. OTHER UTILITIES MAY EXIST ON SITE THAT ARE NOT SHOWN ON THIS PLAN.
 - PROPERTY LINE AND TOPOGRAPHIC INFORMATION IS BASED UPON A FIELD SURVEY.



REFER TO:
INSIGNIFICANT ALTERATION PERMIT #06-0012 (EXPIRED)
OWTS FILE #9818-0641 (EXPIRED)

PROPOSED OWTS NEW CONSTRUCTION PLAN
PREPARED FOR
ANITA COUTO
PLAT 40 LOT 24-4
COLEBROOK ROAD
LITTLE COMPTON, RHODE ISLAND


DATE: AUG 21 2023
Office of Water Resources

SCALE: 1" = 30'
DATE: JUNE 17, 2022


Civil Engineering Concepts, Inc.
36A MAIN STREET
LITTLE COMPTON, RHODE ISLAND 02837
PH: (401) 592-0177
FAX: (401) 592-0178
EMAIL: WSMITHCEC@AOL.COM

REVISIONS:
1) REV 8/15/23: EDITS PER RIDEM COMMENTS


SHEET 1 OF 2
JOB#: 02-177

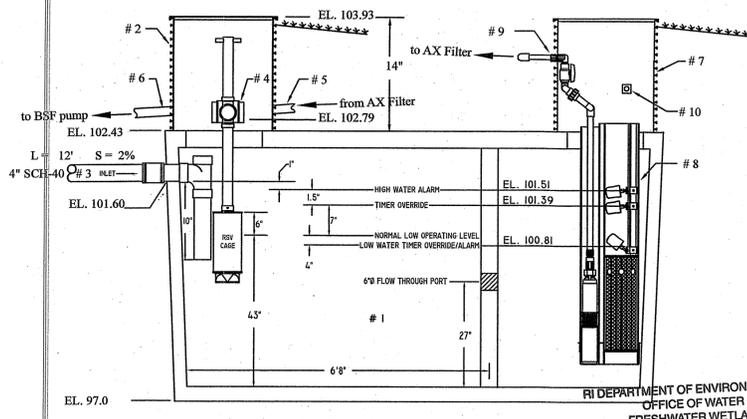

PROCESSING TANK - PROFILE VIEW

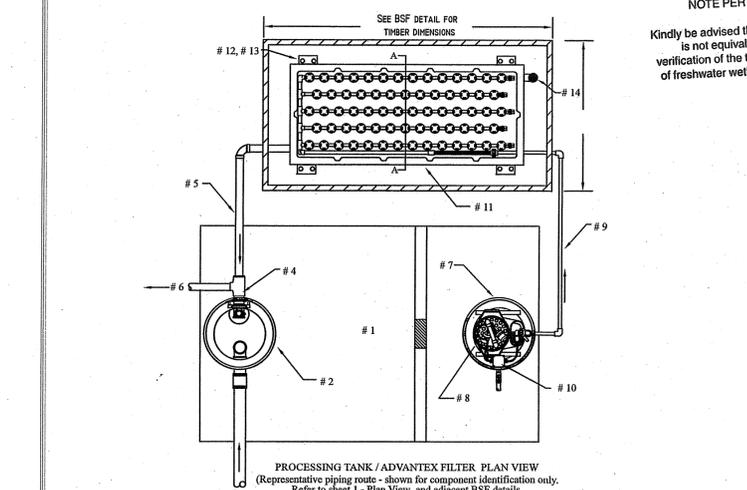


PROCESSING TANK / ADVANTEX FILTER PLAN VIEW

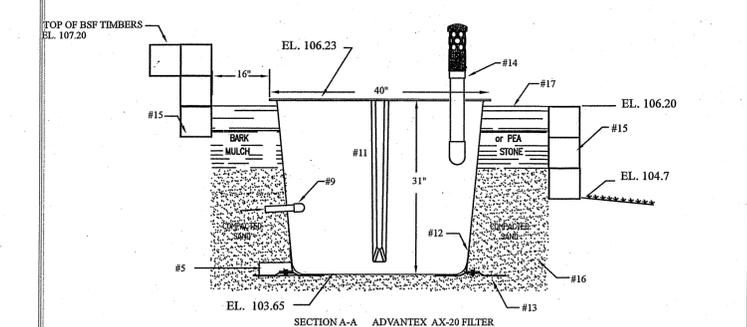

SECTION A-A ADVANTEX AX-20 FILTER

- *1. 1500 gallon H-10 rated Processing Tank with baffles
 - *2. 18" high, 24" dia. PVC inlet riser / fiberglass cover, watertight tank adapter
 - 3. 4" SCH-40 PVC h/dg, sewer inlet pipe w/ tee
 - 4. Recirc. Splitter Valve (manufacturer specified).
 - 5. 2" SCH-40 (gravity) pipe from AX-20 pod to R.S.V.
 - 6. 2" SCH-40 (gravity) pipe from R.S.V. to B.S.F. pump chamber
 - *7. 18" high, 24" dia. PVC riser / fiberglass cover, watertight tank adapter
 - *8. Biotube Recirc. Pump Package w/ OSI P3005, 1/2hp., 1" discharge.
 - 9. 1" Class 200 (SCH-40) PVC from Biotube AX pump to AX pod. Pressure rated fittings required - DWV fittings not permitted
 - 10. Waterproof / Vapor-proof junction/splice box & etc. conduit
 - 11. Advantex AX-20 Recirc. Media Filter pod
 - 12. Factory installed bracket (1 of 4)
 - 13. Contractor installed, factory provided Anti-Floataction Flanges (1 of 2) with stainless steel thru-bolts.
 - 14. OSI Passive Air Vent (ventilation assembly to extend 18" min. above adjacent finished grade)
 - 15. 6" x 6" P.T. Timber wall (same const. method as B.S.F. timber wall) Refer to Advantex AX general note #14 (right side of sheet).
 - 16. Compacted, well draining, granular (sandy) material. 5" minimum under pod.
 - 17. Clean bark mulch (or pea stone) spread from top of sand up to 1" below top of AX pod.
- PROCESSING TANK - BUOYANCY CALCULATIONS
 Tank type: 1500 Gallon H-10 Tank Wt.: 12,400 lbs.
 Weight of Earth Cover (limited to 1.5' of soil on tank): 6,825 lbs.
 Upward lift (neglecting soil friction):
 10.5' (length) x 5.66' (width) x 3.6' (max. submerged depth) x 62.4 lbs./c.f. = 13,350 lbs.
 Safety factor:
 12,400 + 6,825 = 19,225
 19,225 / 13,350 = 1.44

PROCESSING TANK / ADVANTEX FILTER DETAILS NOT TO SCALE

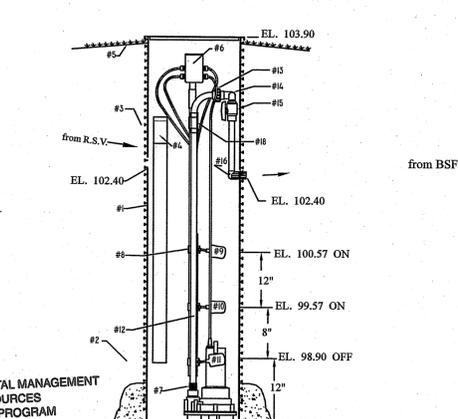



B.S.F. PUMP CHAMBER - BUOYANCY CALCULATIONS

- NOTE PER DEM: Kindly be advised that this Permit is not equivalent to a verification of the type or extent of freshwater wetlands on site
- *1. 24" dia. PVC water tight basin w/ 24" fiberglass cover
 - 2. Backfill material to be compacted (11 lifts) granular (sandy) fill
 - 3. 2" SCH-40 PVC (gravity) from R.S.V. Pressure rated fittings required
 - 4. 2" x 2" x 2" SCH-40 tee with drop pipe extending to lowest float
 - 5. Finished grade to be 1" min. below cover
 - 6. Waterproof / vapor-proof PVC junction / splice box & etc. conduit (junction box, shut off, and disconnect shall be accessible from surface)
 - *7. SCH-40 reducer not required
 - 8. Level Control Float Assembly - removable w/o entry into chamber
 - 9. "ALARM" Float
 - 10. "ON" Float
 - 11. "OFF" Float
 - *12. Discharge piping: 1" Class 200 psi (SCH-40 w/ pressure rated fittings)
 - 13. Threaded Disconnect - accessible from surface w/o chamber entry
 - *14. Drain-back-type assembly required.
 - 15. Fully ported Shut-off.
 - *16. CONCRETE BALLAST REQUIRED - 13 CU. FT. CU. FT. (min)
 - *17. Checkvalve not required. Anti-siphon valve not required.
 - 18. OSI # PF505 Effluent Pump.
 - *19. 3/16ths (min) inch Weephole (directed away from floats)
- Upward lift (neglecting soil friction):
 Assume maximum water table at 1.5' below rim
 1.0' x 1.0' x 3.14 x 4.5' x 62.4 lbs./c.f. = 882 lbs.
 Safety factor: 200 + 1138 = 1.51


B.S.F. PUMP CHAMBER - BUOYANCY CALCULATIONS NOT TO SCALE

ELEVATION SCHEDULE


107.14Finished First Floor
106.0Top of Foundation
101.5Finished Crawl Space
101.84Invert at Building
102.5Average Exist. Grade at Processing Tank
100.5Elevation of Water-Table at Tank
101.60Inlet Invert at Processing Tank
102.40Inlet Invert at BSF Pump Chamber
102.40Invert out of BSF Pump Chamber
107.20Elevation of Top of Pea Stone
106.76Invert at End of Distribution Lateral
106.73Invert at Start of Distribution Lateral
106.50Top of C-33 Filter Sand (33" of C33 sand required)
103.75Bottom of C-33 Filter Sand
103.25Bottom of 6" layer C-33 / Native Soil
103.5Elev. of Water-Table at B.S.F.
105.5Existing Average Grade at B.S.F.
105.70Max. Prop. Grade Adjacent to BSF
104.20Min. Proposed Grade Adjacent to BSF

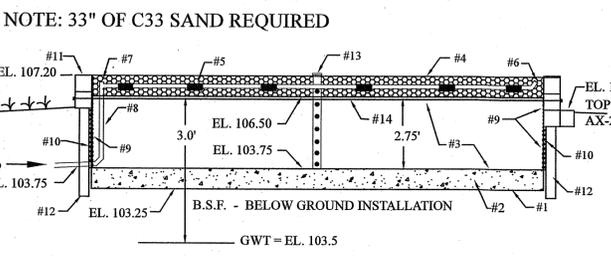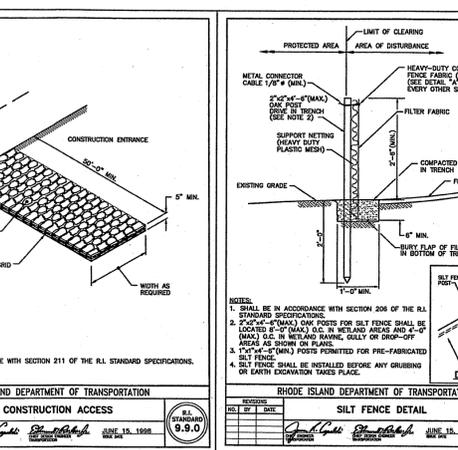


- NOTE: 33" OF C33 SAND REQUIRED
- 1. Scarified and non-compacted native soil. Existing BSF ground surface preparation shall only consist of stripping native "A" and native "B" Horizons (if necessary) down to the specified elevation of the bottom of the sand / C-33 mix.
 - 2. 8" minimum thick layer of evenly mixed Native Mineral Soil (from A/B Horizon) and ASTM C-33 Sand
 - 3. 33" minimum thick layer of non-compacted ASTM C-33 Sand
 - 4. 8" (minimum) thick layer of 3/8ths inch Washed Pea Gravel (4" minimum pea stone layer required over top piping / orifice shields)
 - 5. Class 200 (SCH-40) PVC Laterals with pressure rated fittings and orifices (with shields) spaced and sized as specified in detail below.
 - 6. 90-degree sweep or 45-degree elbow with threaded female cap at end of Lateral.
 - 7. Class 200 (SCH-40) PVC Manifold sized as specified in detail below.
 - 8. Class 200 (SCH-40) PVC Transport pipe sized as specified in detail below. Installation sleeved over vertical portion of transport pipe inside B.S.F.
 - Install "tee" and threaded plug at 90-degree bend / connection to Manifold (allows cleaning access to Transport pipe).
 - 9. 30 mil. PVC liner
 - 10. 1/2" non-PT plywood support frame below grade
 - 11. 6" x 6" P.T. timber support frame above ground
 - 12. 4" x 4" vertical non-PT vertical support timbers to brace 6" x 6" timber frame construction and plywood frame. Recommend 3 vertical timbers at each corner and every 10' o.c.
 - 13. 4" dia. filter fabric wrapped SDR-35 inspection well with removable cap
 - 14. 1/2 inch (min) dia. threaded tie rods required when 6" x 6" timbers exceed 2 courses in height or 15' in length. Refer to detail below and Bottomless Sand Filter note # 28.

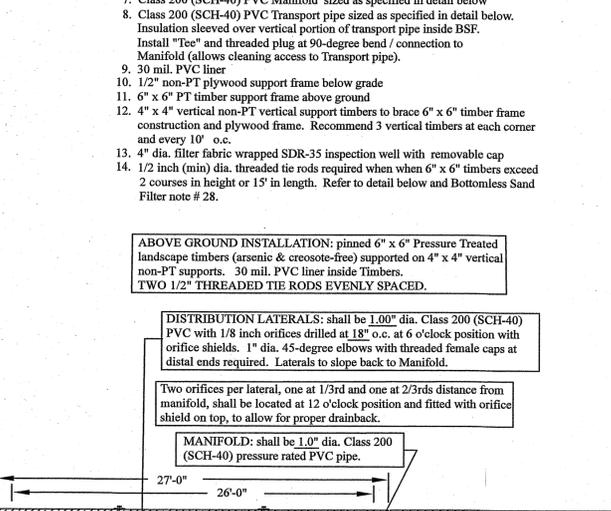


B.S.F. PUMP CHAMBER DETAIL NOT TO SCALE

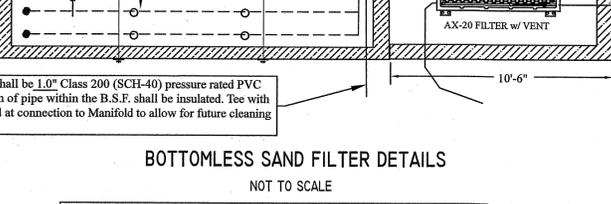

BOTTOMLESS SAND FILTER DETAILS NOT TO SCALE

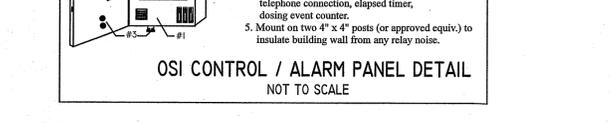

OSI CONTROL / ALARM PANEL DETAIL NOT TO SCALE

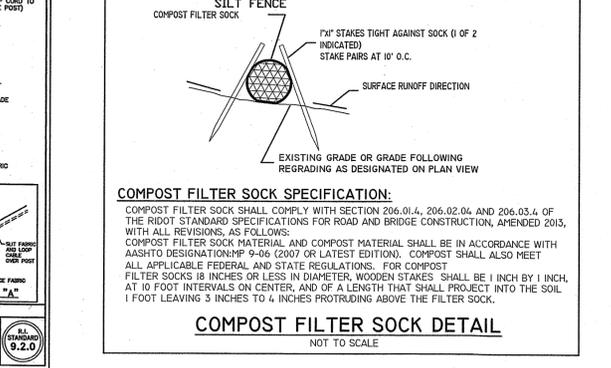

COMPOST FILTER SOCK DETAIL NOT TO SCALE

- GENERAL CONSTRUCTION NOTES:
1. Designer recommends installing the system septic system during dry months (June - October) to avoid complications with a high water table or excessive surface water runoff during construction. A HIGH WATER TABLE OR SATURATED GROUND CONDITIONS DURING CONSTRUCTION ACTIVITIES COULD COMPROMISE THE QUALITY AND LIFE EXPECTANCY OF THE SYSTEM.
 - 1a. All construction shall conform to the State of Rhode Island and Providence Plantations Department of Environmental Management - Rules and Regulations Establishing Minimum Standards Relating to Location, Design, Construction, and Maintenance of Individual Sewage Disposal Systems as most recently amended, and in accordance with the Bottomless Sand Filter Guidelines Document (as most recently amended).
 2. All work shall be done in a workmanlike manner with lines laid as straight as possible and joints made watertight. All work shall be performed by an Installer licensed in the State of Rhode Island and certified for the installation of B.S.F. - type systems by RI DEM and the Vendor. Verification of installer's certification may be required by Designer prior to "start of construction" request by installer.
 3. DESIGNER TO BE NOTIFIED 72 HOURS PRIOR TO THE START OF ISDS CONSTRUCTION. CONTRACTOR IS TO ENSURE THAT DESIGNER IS NOTIFIED 2 WORKING DAYS IN ADVANCE OF ANY REQUIRED INSPECTIONS SO PROPER NOTIFICATION TO RI DEM CAN BE MADE.
 4. Work shall not continue until the previous stage is inspected and approved. CONTRACTOR OR HOMEOWNER SHALL PROVIDE DESIGNER WITH A COPY OF THE RECORDED MAINTENANCE AGREEMENT prior to Designer's issuance of Certificate of Construction.
 5. DIG-SAFE NOTIFICATION IS REQUIRED PRIOR TO ANY EXCAVATION. Any underground utilities shown are approximate only and are based on limited availability of plans, visual observation, and local knowledge. ACTUAL LOCATIONS ARE TO BE VERIFIED BY CONTRACTOR prior to excavation through Dig-Safe procedures and any local utility department as necessary.
 6. AREA TO BE UTILIZED FOR B.S.F. SHALL REMAIN CLEAR OF ALL VEHICLES, EQUIPMENT, AND STOCKPILED MATERIALS. The B.S.F. area shall be marked with caution tape to restrict access. Compaction or smearing of native soil will compromise the operation of the B.S.F.
 7. PROPER SIZE HOLE SAWS, IN GOOD CONDITIONS, ARE TO BE USED FOR THE INSTALLATION OF CONDUIT/PIPING GROMMETS. Refer to, and follow, required hole sizes specified in manufacturer's installation documentation. The use of incorrectly sized hole saw will result in improperly seated grommets. Any conduit/piping installed into polyethylene riser or tank that is not watertight will NOT be approved by the Designer.

- SEPTIC/RECIRCULATION TANK: Gallonage as specified on Processing Tank Detail
1. Equipped with suitable cast-in-place PVC mounting flange for detail-specified diameter inlet & outlet PVC risers. Watertight bonding epoxy (or other proper adhesive) required between tank adapters and risers. ACCESS COVERS ARE NOT TO BE COVERED WITH SOIL. Final load placement (elevation) shall be at least 1" below the access covers and graded away from tank.
 2. ALL TANK SEAMS, riser connections (if any) and all plumbing joints are to be installed 100% watertight, sealed with suitable gasket material, or other bonding agent suitable for that specific component. Any knock-out(s) in the bottom of the tank shall remain sealed or be sealed with suitable plug and hydraulic cement. Unused inlet/outlet knock-outs shall be sealed with hydraulic cement. Static water test required on tank following installation. The life span of the system would be compromised by the intrusion of any groundwater.
 3. For proper operation, the septic tank shall be inspected annually and pumped when any solids accumulation exceeds 1/3rd liquid depth.
 4. Manufacturer's mounting hardware shall be utilized for Recirc. Splitter Valve installation and pump vault components. All materials and construction shall meet the manufacturer requirements and applicable building, plumbing, electrical, and safety codes. Third party or alternate generic parts requiring substantial field modifications to fit shall not be permitted.
 5. Recirc. compartment Biotube Pump Vault shall be OSI Effluent Pumping System package specifically for discharging to the Advantex AX Filter (operating in Mode 3), and OSI control panel for operating a linked pump system (2 pumps in separate locations) unless otherwise specified on plan.
 6. For additional PUMP INFORMATION, see details contained within this plan, accompanying documentation and manufacturer's published information provided at the time of pump purchase. The information contained within this plan is intended to provide schematic requirements only. Actual manufacturer's shop drawings are to be coordinated with the component supplier, including all accessories such as alarms, floats, etc. that are compatible with the pumps. Odd components requiring extensive modification to the system are not permitted.
 7. A SIGN shall be posted in the vicinity of pump manholes warning of the potential of hazardous sewer gases and the need for proper confined space entry, venting, and air monitoring prior to working on the pump assembly.
 8. ELECTRICAL WIRING is to be enclosed in suitable conduit with proper fittings at each end to maintain a watertight connection and prevent transport of vapors/gas from the components to the control panel and building. Electrical installation shall conform to all applicable local/state regulations.

- ADVANTEX AX RECIRCULATING MEDIA FILTER:
9. THE AX POD SHALL BE LAID LEVEL ON A 5" (min) thick bed of compacted sand/gravel. When installed above the processing tank, it is recommended that a frame of non-P.T. 2" x 6" lumber be constructed on top of the processing tank to support the sand/gravel, preventing material washout from under the AX pod.
 10. PROPER COMPACTION OF WELL-DRAINED GRANULAR MATERIAL under, along side, and above the four anti-floataction flanges is necessary to ensure the pod will not float. If concrete ballast is specified on plan, compacted material under and along side of the flanges is required to prevent settlement and air pockets that may fill with water resulting in floatation.
 11. HAND COMPACTED OF backfilled material around the AX pod and related piping is required to prevent settlement (no DWV-type fitting permitted).
 12. All piping connected to the AX unit shall be Class 200 (SCH-40 or SDR-21) pressure rated piping with pressure rated fitting (no DWV-type fitting permitted).
 13. The Passive Air Vent must be located less than 20' from the AX pod. 2" SCH-40 PVC connector pipe shall slope down from vent to pod to allow draining. Bottom of the perforated air intake shall be 12" minimum above finished grade.
 14. Any specified courses of 6" x 6" P.T. timbers surrounding the pod shall be constructed the same as the B.S.F. timber frame. Compacted well-drained granular soil required below timbers. Timbers shall extend past the sides & ends of pod to allow for vent, plumbing, and flanges.
 15. Mulch or pea stone covered with mulch shall be placed between the pod and the timbers, extending to the top of the timbers.
 16. Finished grade shall slope down and away from all exposed covers to prevent surface water from flooding and ponding along sides of the pod and tank.
- B.S.F. PUMP SYSTEM:
17. OSI # 6 deep PVC secondary pump chamber. Any weepholes shown shall not be directed toward floats. Pump floats shall be controlled by the septic/recirculation tank Biotube Pump Vault Control Panel. Discharge piping shall be equipped with an anti-siphon valve only when B.S.F. is located below the pump chamber "OFF" float elevation. Final load placement (elevation) shall be at least 1" below the fiberglass/PVC access cover and graded away from chamber.
 18. TRANSPORT LINE shall be Class 200 (SCH-40) pressure piping (with pressure rated fittings) laid at consistent slope up to the B.S.F. floating drainback, unless transport pipe is laid a minimum 3' deep below finished grade. A minimum of 15' earth cover over pipe is required unless insulation is specified. Transport pipe shall be threaded onto pump basin's flexible discharge pipe. 1 cu. ft. (min) concrete thrust blocks required at all angle points.
 19. B.S.F. PUMPS shall be as specified, with indicated discharge diameter, for pressurizing the B.S.F. Any pump substitution shall require the Designer's review of the substitute pump specifications and pump curve.
 20. B.S.F. PUMP CALCULATIONS input data/pump curve is provided on attachment with application. Lateral lengths & manifold lengths used for pump specifications reflect that piping does not extend to the far edges of the B.S.F. filter box.

- ELECTRICAL CONTROL / ALARM PANEL:
21. CONTROL PANEL shall be an OSI pump-matched NEMA-4 rated waterproof/lockable unit with visual alarms and programmable timer that operates both OSI AX Media Filter pump unit and B.S.F. pump ON SAME CIRCUIT. Panel to be mounted adjacent to EXTERIOR WALL of the building within view of the tanks. Outside face of panel shall be equipped with high-intensity alarm light and alarm silence button that shall automatically reactivate after 12 hours.
 22. A START UP TEST is required to be performed by the installer / maintenance provider and witnessed by Designer of the AX pumping system, the B.S.F. pumping system, and pressure (head) testing of the B.S.F. laterals. Any subsequent electrical work shall include the Electrician's verification that the electricity is properly restored to the Control Panel.

- BOTTOMLESS SAND FILTER (B.S.F.):
23. B.S.F. shall be constructed as shown with materials as specified in the details. Installation of a 4" dia. perforated (filter fabric wrapped) inspection well required.
 24. Sand media material shall conform to ASTM C33 sand (sieve) requirements with less than 1% fines passing number 200 sieve. Bank run sand or conventional ISDS sand/gravel is not permitted. DESIGNER MAY REQUIRE SIEVE ANALYSIS FROM SAND SUPPLIER WITHIN 4 DAYS PRIOR TO SAND DELIVERY.
 25. MANIFOLD: Dia. as specified on detail and shall be Class 200 (SCH-40) PVC. All fittings shall be pressure rated (DWV fittings not recommended).
 26. DISTRIBUTION LATERAL: Dia. specified on detail and shall be Class 200 (SCH-40) PVC with 1/8" orifice holes (drilled with new bit) and fitted slotted cold weather orifice shields spaced at intervals specified. Laterals shall be laid with slight pitch back to the manifold. Distal ends of laterals shall be equipped with a 45-degree elbow and 3/4" or 1" threaded female end cap. Sweep elbows extending to the surface are not to be installed on ends. All fittings shall be pressure rated (DWV fittings not acceptable).
 27. LEACHING AREA EXCAVATION shall be level and scarified as shown on B.S.F. cross-section detail. Care shall be taken to avoid compaction of remaining soil. Excavation of native material below the B.S.F. shall only be to the extent designated on the plan. Where the B.S.F. is located completely above ground, material removal shall only consist of stripping grass / thatch layer and A horizon. PREPARED NATIVE SOIL SURFACE (BOTTOM INSPECTION) SHALL BE INSPECTED BY DESIGNER PRIOR TO PLACEMENT OF 6" THICK LAYER OF SAND/SOIL MIX.
 28. ABOVE GROUND B.S.F. SUPPORT FRAMING shall consist of 6" x 6" pressure treated timbers drilled and pinned to the soil with #3 or #4 rebar and screwed/nailed together at the corners and joints. BELOW GROUND CONSTRUCTION shall utilize 1/2" min. thickness P.T. plywood in place of timbers. 30 ml. liner shall be placed inside timbers and plywood.
 29. Where more than two courses of 6" x 6" timbers are exposed, 1/2" dia. THREADED GALVANIZED ROD(S) with 2" dia. galvanized washers and nuts shall be installed in the second timber down from the top (to support timbers from bowing out), evenly placed along the length of B.S.F. (approximately 12' o.c.).
 30. TREES OR SHRUBS shall not be planted within 10' of the B.S.F. without vertical placement of a suitable root barrier fabric installed at least 3' beyond the B.S.F. and extending from 4" below finished grade to 1' below the bottom of the native soil/B.S.F. sand interface.
 31. HEAVY EQUIPMENT shall not be operated over the components or the prepared leaching area during installation. RUBBER Tired MACHINERY is NOT to be driven over the prepared natural soil base or sand/stone bed during system installation.
 32. B.S.F. IS NOT TO BE COVERED WITH topsoil or any other type of cover material that will restrict air flow. Any accumulated weeds, grass, or foreign material on the filter shall be removed by hand labor. Pea gravel surface must remain fully exposed to atmosphere.
 33. ALL EXISTING OR PROPOSED (if any) WELLS within 200' of proposed ISDS are shown.
 34. ALL EXISTING OR PROPOSED (if any) PUBLIC WELLS within 500' of proposed ISDS are shown.
 35. ALL EXISTING OR PROPOSED SEPTIC SYSTEMS within 100' of any proposed or existing on-site well are shown.
 36. NO PARKING is permitted in the vicinity of the ISDS.
 37. NO DRAINS ALLOWED WITH 25' of proposed ISDS.
 38. A BACKUP GENERATOR (adequate for supplying the pumps in case of electrical failure) is strongly recommended.
 39. PROPERTY LINES as depicted on this plan are approximate only based on Assessor Tax Maps and are not the result of a boundary survey.

- A MANUFACTURER-APPROVED MAINTENANCE CONTRACT for the pump/filter systems is required to be filed in the applicable Town Hall Land Evidence records office. Contract must be kept current as a condition of approval.

RI DEPARTMENT OF ENVIRONMENTAL MANAGEMENT
 OFFICE OF WATER RESOURCES
 FRESHWATER WETLANDS PROGRAM

APPROVED WITH CONDITIONS AS SPECIFIED IN THE LETTER OF APPROVAL
 DATED: AUG 30 2023 FILE # 22-0376
 NO CHANGES ALLOWED WITHOUT PRIOR APPROVAL
 APPROVED PLANS MUST BE AT CONSTRUCTION SITE

WILLIAM F. SMITH
 REGISTERED PROFESSIONAL ENGINEER

PROPOSED OWTS NEW CONSTRUCTION PLAN
 PREPARED FOR ANITA COUTO
 PLAT 40 LOT 24-4
 COLE BROOK ROAD
 LITTLE COMPTON, RHODE ISLAND

NOT TO SCALE DATE: JUNE 17, 2022

Civil Engineering Concepts, Inc.
 34A MAIN STREET
 LITTLE COMPTON, RI 02837
 PH: (401) 592-0177
 FAX: (401) 592-0178
 EMAIL: wsmithccc@aol.com

REVISIONS: 01/8/15/23: NO EDITS THIS SHEET
 SHEET 2 OF 2