

GENERAL NOTES
(ONLY CIRCLED NOTES APPLY)

- DISTRIBUTION BOX TO BE 3 SQ.FT. MIN. & BE PROVIDED A SUITABLE BAFFLE.
- SEPTIC TANK SHALL BE 2 COMPARTMENT, WITH FILTER & AN INLET TEE.
- MAINTAIN ELEV. 76.67 FOR 5 FEET AROUND THE LEACHING FIELD PERIMETER AND ELEVATION 70.84 FOR 10 FT. AROUND THE SEPTIC TANK, UNLESS OTHERWISE NOTED. UNLESS SHOWN ON PLAN.
- THERE ARE NO WELLS WITHIN 200 FT. OF THE PROPOSED SEPTIC SYSTEM.
- THERE ARE NO SEPTIC SYSTEMS WITHIN 100 FT. OF THE PROPOSED WELL, UNLESS SHOWN ON PLAN.
- THERE ARE NO DRAINS EXISTING OR PROPOSED WITHIN 25 FT. OF THE PROPOSED SEPTIC SYSTEM, UNLESS SHOWN ON PLAN.
- SCHEDULE 35-SDR P.V.C. PIPE FOR ALL ISDS PIPING, UNLESS OTHERWISE NOTED.
- THE LEACHING FIELD AND EXTENDING 5 FT. INTO THE LEACHING FIELD PERIMETER FROM SIDE WALLS MUST BE STRIPPED OF TREES, BRUSH, TOPSOIL, SUBSOL, UNDESIRABLE MATERIAL, AND SOIL CONTAINING FINES AND THE EXCAVATION SCARIFIED AND BACKFILLED WITH CLEAN COURSE GRAVEL.
- A MINIMUM OF 10 FT. SHOULD BE MAINTAINED BETWEEN LEACHING FIELD AND NEIGHBORING TREES AND SHRUBS. THE ROOT SYSTEMS OF WATER-LIVING TREES AND SHRUBS CAN CAUSE DAMAGE TO LEACHING, REMOVE PERIMETER ROOTS AND MAINTAIN A ROOT FABRIC BARRIER BETWEEN WATER-LIVING TREES AND THE LEACHING FIELD.
- FOR PROPER PERFORMANCE, THE SEPTIC TANK AND THE LEACHING FIELD SHOULD BE INSPECTED AT LEAST ONCE A YEAR & WHEN THE TOTAL DEPTH OF SOIL AND SOLIDS EXCEED 1/3 THE LIQUID DEPTH OF THE TANK, THE TANK SHOULD BE PUMPED.

GENERAL NOTES - (CONTINUED)

- THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE PERFORMANCE OF THIS SYSTEM UNLESS CONSTRUCTED AS SHOWN. ANY OTHER ALTERATIONS MUST BE APPROVED IN WRITING BY THE DESIGNER.
- PROPERTY LINES, UNLESS OTHERWISE INDICATED CONFORM TO A CLASS II STANDARD AS ADOPTED BY THE RHODE ISLAND BOARD OF PROFESSIONAL LAND SURVEYORS.
- THERE ARE NO PUBLIC WELLS WITHIN 500 FT. OF THE PROPOSED O.W.T.S., EXCEPT AS SHOWN.
- THERE ARE NO COASTAL PONDS OR TRIBUTARIES THERETO INCLUDING STORM AND SUBSURFACE DRAINS DIRECTLY DISCHARGING THERETO WITHIN 200 FT. OF THE PROPOSED I.S.D.S., EXCEPT AS SHOWN.
- RE-PLUMB EXISTING STRUCTURE AS NECESSARY TO MATCH THE INVERTS OF THE PROPOSED SEPTIC SYSTEM.
- BENCHMARK TO BE SET WITHIN 150 FT. OF THE PROPOSED O.W.T.S. LOCATION, PRIOR TO CONSTRUCTION.
- ALL OTHER DESIGN, CONSTRUCTION AND MAINTENANCE REQUIREMENTS, WHETHER NOTED HEREON, OR NOT SHALL CONFORM WITH THE RULES & REGULATIONS ESTABLISHING MINIMUM STANDARDS RELATING TO LOCATION, DESIGN, CONSTRUCTION AND MAINTENANCE OF ONSITE WASTEWATER TREATMENT SYSTEMS, NOV. 25, 2018 BY R.I.D.E.M. AUTHORITY, CHAPTER 42-15 PURSUANT TO CHAPTERS 42-17.1, 5-56, 5-56.1, 23-19.5, AND 23-24.3, OF THE RHODE ISLAND GENERAL LAWS OF 1956, AS AMENDED.

NOTICE TO OWNER & INSTALLER - THE EXACT LOCATION OF THE PROPOSED LEACHING SYSTEM SHALL BE FIELD STAKED BY THE LICENSED DESIGNER AS PART OF HIS CONSTRUCTION OBSERVATION CONTRACT WITH THE OWNER. A 72 HOUR NOTICE IS HEREBY REQUIRED PRIOR TO THE START OF ANY CONSTRUCTION. A PRE-CONSTRUCTION MEETING BETWEEN THE LICENSED DESIGNER & LICENSED INSTALLER AT THE SITE IS REQUIRED FOLLOWING THE FIELD STAKING OF THE SYSTEM LOCATION.

A. THE DESIGNER MUST AT A MINIMUM, INSPECT AND MAKE MEASUREMENTS, WHERE APPROPRIATE, OF THE FOLLOWING COMPONENTS AND STEPS IN THE INSTALLATION OF THE ISDS:

- THE EXPOSED BOTTOM OF THE EXCAVATION FOR THE LEACH FIELD;
- THE SIZE AND CONDITION OF ALL STRUCTURES SUCH AS THE SEPTIC TANK, D-BOX, & THE ELEVATIONS OF ALL PIPE INVERTS;
- ALL SAND MEDIA, PEA STONE AND AGGREGATE IS IN ACCORDANCE WITH SPECIFICATIONS;
- COMPLETED INSTALLATION PRIOR TO COVERING;
- IF CONDITIONS ARE ENCOUNTERED DURING CONSTRUCTION WHICH INDICATE THAT THE SYSTEM CANNOT BE INSTALLED OR IS NOT INSTALLED IN ACCORDANCE WITH THE PERMIT, OR ANY TERMS AND CONDITIONS CONTAINED THEREIN, THE DESIGNER SHALL NOTIFY THE DIRECTOR AS SOON AS POSSIBLE, BUT NO LATER THAN 24 HOURS AFTER DISCOVERY. THE DESIGNER SHALL ISSUE WRITTEN GUIDANCE ON SPECIFICATIONS FOR CONSTRUCTION TOLERANCES AS WELL AS CONDITIONS UNDER WHICH AS-BUILT PLANS AND REDESIGNED PLANS ARE REQUIRED. THE INSTALLER SHALL STOP CONSTRUCTION IF CONDITIONS ARE SUCH THAT A REDESIGN IS REQUIRED. NOTIFICATION IS NOT REQUIRED IF ALL DESIGN ELEMENTS ARE WITHIN THE TOLERANCES ESTABLISHED BY THE DEPARTMENT THROUGH WRITTEN GUIDANCE.

B. THE OWNER OF THIS SEPTIC SYSTEM SHALL CONTINUOUSLY MAINTAIN A SERVICE CONTRACT WITH A QUALIFIED AND CERTIFIED SERVICE PROVIDER, FOR THE LIFE OF THE SEPTIC SYSTEM. THIS APPLIES TO ALL POSSIBLE FUTURE OWNERS OF THIS SEPTIC AS WELL. A COPY OF THIS SERVICE CONTRACT SHALL BE FILED IN THE TOWN LAND EVIDENCE RECORDS.

C. THE INSTALLER SHALL PROVIDE THE LICENSED DESIGNER AT MINIMUM THE INFORMATION BELOW THAT CAN BE USED TO VERIFY THAT THE INSTALLATION OF THE ISDS WAS PERFORMED AS SPECIFIED:

- LIST OF ALL MATERIALS USED, THEIR SOURCE, AND THE DATES DELIVERED TO THE SITE; AND
- PRODUCT SPECIFICATION SHEETS, IF DIFFERENT FROM THOSE SPECIFIED IN THE APPROVED DESIGN; AND
- A MINIMUM OF TWO PHOTOGRAPHS OF THE SYSTEM BEING INSTALLED;

D. CERTIFICATE OF CONSTRUCTION

- THE DESIGNER THAT IS RESPONSIBLE FOR THE SYSTEM INSTALLATION IN ACCORDANCE WITH RULE 43, SHALL COMPLETE A CERTIFICATE OF CONSTRUCTION THAT CERTIFIES THAT THE O.W.T.S. WAS INSTALLED IN CONFORMANCE WITH THE APPROVED APPLICATION, PLANS, SPECIFICATIONS, APPLICABLE STATUTES AND REGULATIONS AND THAT HE OR SHE IS RESPONSIBLE FOR HAVING OBSERVED THE INSTALLATION. THE CERTIFICATE OF CONSTRUCTION SHALL BE ON FORMS PROVIDED BY THE DIRECTOR.
- THE CERTIFICATE OF CONSTRUCTION SHALL BE SUBMITTED TO THE DIRECTOR AFTER THE O.W.T.S. BUILDING FOUNDATION, DRINKING WATER WELL, AND OTHER APPURTENANCES, AS MAY BE SPECIFIED IN WRITTEN DEPARTMENT GUIDANCE AND HAVE BEEN CONSTRUCTED IN ACCORDANCE WITH THE DESIGN PLAN.
- IN ADDITION TO THE CERTIFICATION IN RULE 43, ABOVE, THE CERTIFICATE OF CONSTRUCTION SHALL INCLUDE, BUT NOT BE LIMITED TO, THE FOLLOWING:
(A) NAME AND LICENSE NUMBER OF THE DESIGNER;
(B) NAME AND LICENSE NUMBER OF THE INSTALLER;
(C) DISTANCES FROM TWO BUILDING FOUNDATION CORNERS TO THE SEPTIC TANK MANHOLE, TO THE DISTRIBUTION BOX, AND TO THE LEACH FIELD CORNERS.

E. ONCE THE DESIGNER HAS CERTIFIED THAT THE O.W.T.S. HAS BEEN PROPERLY INSTALLED, THE DESIGNER SHALL PROVIDE INFORMATION AND RECOMMENDATIONS TO THE OWNER OF THE O.W.T.S. ON SYSTEM SPECIFIC OPERATION AND MAINTENANCE PRACTICES TO PREVENT AGAINST PREMATURE SYSTEM FAILURE AND POLLUTION OF THE WATERS OF THE STATE.

F. THE DESIGNER IS NOT RESPONSIBLE FOR ANY NEGLECT ACT OR OMISSION OF A USER OF AN O.W.T.S., INCLUDING BUT NOT LIMITED TO, FAILURE TO PROPERLY USE AND MAINTAIN THE SYSTEM, WHICH CAUSES DAMAGE TO THE ISDS.

G. THE OWNER OF THIS SEPTIC SYSTEM SHALL CONTINUOUSLY MAINTAIN A SERVICE CONTRACT WITH A QUALIFIED AND CERTIFIED SERVICE PROVIDER, FOR THE LIFE OF THE SEPTIC SYSTEM. THIS APPLIES TO ALL POSSIBLE FUTURE OWNERS OF THIS SEPTIC AS WELL. A COPY OF THIS SERVICE CONTRACT SHALL BE FILED IN THE TOWN LAND EVIDENCE RECORDS.

PROPOSED NEW DWELLING & ONSITE WASTEWATER TREATMENT SYSTEM DESIGN & SITE PLAN

FOR LAND BELONGING TO
MICHAEL G. MCCARTHY LIVING TRUST

LAND SITUATED AT 170 GIBSON AVENUE ON
ASSESSOR'S PLAT "Z" / LOT 2

SITUATED IN THE TOWN OF
NARRAGANSETT, RHODE ISLAND

DATE: SEPT. 12, 2022; SCALE: 1"=40'
REVISED: NOV. 30, 2022; PER RIDEM-FWW & O.W.T.S.
DATE: DEC. 12, 2022; 3' WT. SEPARATION / O.W.T.S.

PREPARED BY:
EASTERBROOKS & ASSOCIATES, LLC
2505 BOSTON NECK ROAD SAUNDERSTOWN, R.I. 02874 TEL. 401.667-7770

DEC 14 2022

Office of Water Resources

SHEET 1 OF 2 SHEETS

SOIL STABILIZATION & PLANTING PROGRAM:

ACCEPTABLE PLANTING MATERIALS:

LOAM - SHALL CONSIST OF LOOSE, FRIABLE, SANDY-LOAM OR LOAM TOPSOIL FREE OF A MIXTURE OF SUBSOIL, REFUSE, STUMPS, ROOTS, ROCKS, BRUSH AND ANY OTHER MATERIAL WHICH WILL PREVENT THE FORMATION OF A SUITABLE SEED BED.

SEED MIXTURES - ALL LEGUME SEED SHALL BE INOCULATED WITHIN 24 HRS. BEFORE MIXING AND PLANTING WITH APPROXIMATE INOCULUM FOR EACH VARIETY. ALL INOCULANT SHALL BE FRESH AND USED WITHIN THE DATE LIMIT PRESCRIBED BY THE MANUFACTURER.

GRASS MIX FOR RELATIVELY FLAT SLOPES: (LESS THAN 3:1)
 RED FESCUE - CHEWING PENNLAWN OR CREEPING70% (BY WEIGHT)
 KENTUCKY BLUEGRASS15% (BY WEIGHT)
 COLONIAL BENT GRASS - ASTORIA OR EXETER5% (BY WEIGHT)
 PERENNIAL RYEGRASS10% (BY WEIGHT)

SEEDING RATE = 100 LBS. PER ACRE

GRASS MIX FOR RELATIVELY STEEP SLOPES: (GREATER THAN 3:1)
 RED FESCUE - PENNLAWN OR CREEPING75% (BY WEIGHT)
 PERENNIAL RYEGRASS5% (BY WEIGHT)
 COLONIAL BENT GRASS - ASTORIA OR EXETER5% (BY WEIGHT)
 BIRDFOOT, TREFOIL - EMPIRE15% (BY WEIGHT)

SEEDING RATE = 100 LBS. PER ACRE

THE ACCEPTED PLANTING SEASON SHALL BE BETWEEN APRIL 1st AND OCT. 15th. THE CONTRACTOR SHOULD COORDINATE ON ALL DISTURBED AREAS. A MINIMUM OF 4" OF LOAM ON AREAS UP TO 10% GRADE AND 6" OF LOAM ON GRADES GREATER THAN 10%.

GENERAL NOTES & GUIDELINES:

- IT SHALL BE THE CONTRACTORS SOLE RESPONSIBILITY TO OBTAIN ANY AND ALL PERMITS BY THE STATE AND MUNICIPALITIES IN WHICH THE WORK IS BEING PERFORMED, PRIOR TO THE START OF ANY WORK.
- IT SHALL BE THE CONTRACTORS SOLE RESPONSIBILITY TO DOCUMENT EXISTING CONDITIONS AND SURROUNDING PROPERTIES AND MAINTAIN THE INTEGRITY OF THE SAME. ANY DAMAGE TO AND THE COST OF REPAIR OF UTILITIES, ROADWAYS, STRUCTURES AND SURROUNDING PROPERTY SHALL BE FULLY BORNE BY THE CONTRACTOR.
- CONTACT DIG-SAFE AND UTILITY COMPANIES FOR EXACT ON-SITE LOCATION OF EXISTING UNDERGROUND UTILITIES AT LEAST 48-HRS. PRIOR TO START OF CONSTRUCTION.
- THE CONTRACTOR SHALL OBTAIN REQUIRED INSPECTION SCHEDULE OF THE MUNICIPALITY, STATE, UTILITY COMPANIES AND ALL OTHER REQUIRED PARTIES AND SHALL STRICTLY TO THOSE REQUIREMENTS.
- THE CONTRACTOR SHALL ADHERE TO ALL CONDITIONS OF CONSTRUCTION APPROVALS AND SHALL KEEP A COPY OF ALL APPROVALS ON-SITE DURING CONSTRUCTION. CONTRACTOR SHALL READ ALL APPROVALS PRIOR TO START OF CONSTRUCTION AND SHALL CLARIFY ANY QUESTIONS OR CONCERNS PRIOR TO START OF CONSTRUCTION.



STORMWATER MANAGEMENT FOR SINGLE FAMILY RESIDENTIAL LOT DEVELOPEMENT Rain Garden Sizing

DESIGN CALCULATIONS

DWELLING ROOF AREA = 8,000. SF
 GARAGE BARN ROOF AREA = 5,000. SF
 PICKLEBALL COURTS = 5,400. SF
 CONCRETE DRIVEWAY = 1,200. SF

TOTAL ROOF/IMPERVIOUS AREA = 19,600.S.F.

Tables 7. and 8. Rain Garden Sizing Guidance

Rain Garden No.1 Surface Area in Silty Soils
 1550 S.F. @ 10" Average Depth Rain Garden = 1,286.C.F. / 8,040.SF ROOF/IMPERVIOUS PROVIDED (1550.S.F. @ 10" AVG. DEPTH ACCOMMODATED = 1286 / 160.SF = 8,040.S.F.)

Rain Garden No.2 Surface Area in Silty Soils
 1150 S.F. @ 12" Average Depth Rain Garden = 1150.CF / 7,187.SF ROOF/IMPERVIOUS PROVIDED (1150.S.F. @ 10" AVG. DEPTH ACCOMMODATED 954 / 160.SF = 7,187.S.F.)

Rain Garden No.3 Surface Area in Silty Soils
 800 S.F. @ 12" Average Depth Rain Garden = 800.CF / 5,000.SF ROOF/IMPERVIOUS PROVIDED (800.S.F. @ 12" AVG. DEPTH ACCOMMODATED / 160.SF = 5,000.S.F.)

TOTAL ROOF/IMPERVIOUS AREA ALLOWED=20,227.S.F.

REFER TO RHODE ISLAND STORMWATER MANAGEMENT GUIDANCE FOR SINGLE FAMILY RESIDENTIAL LOT DEVELOPMENT STANDARDS.

SILT SOCK INSTALLATION GUIDELINES

SLOPE INTERRUPTION
 1. A SLIGHT EXTENSION MAY BE REQUIRED ON STEEPER SLOPES TO PROVIDE A BETTER GRADING CONTACT.
 2. REMOVE ALL DEBRIS FROM THE DOWN-SLOPE SIDE OF THE SILT SOCK.
 3. LOCATE THE SOCK ON A SLOPE THAT HAS REACHED 1/2 OF EFFECTIVE HEIGHT OF SOCK.
 4. LOCATE THE SOCK ON A SLOPE THAT HAS REACHED 1/2 OF EFFECTIVE HEIGHT OF SOCK TO ENHANCE PERFORMANCE.
 5. WOODEN STAKES 2" DIA. (MINIMUM) ARE REQUIRED.

PERIMETER CONTROL & OVERLAPPING
 NOTE: OVERLAP BASED ON FLOW DIRECTION.
 1. OVERLAP 4" ON SLOPES.
 2. OVERLAP 6" ON FLAT SURFACES.
 3. OVERLAP 8" ON SLOPES GREATER THAN 10%.

INLET PROTECTION
 SAND BAG OR BLOCK
 1. IF GUARD RAIL IS NOT AVAILABLE, USE A CONCRETE BLOCK.
 2. SAND BAG OR BLOCK
 3. SAND BAG OR BLOCK

PYRAMID INSTALLATION STAKING
 1. STAKES OR STRIPS
 2. SOCKS
 3. SOCKS
 4. SOCKS
 5. SOCKS
 6. SOCKS
 7. SOCKS
 8. SOCKS
 9. SOCKS
 10. SOCKS
 11. SOCKS
 12. SOCKS
 13. SOCKS
 14. SOCKS
 15. SOCKS
 16. SOCKS
 17. SOCKS
 18. SOCKS
 19. SOCKS
 20. SOCKS
 21. SOCKS
 22. SOCKS
 23. SOCKS
 24. SOCKS
 25. SOCKS
 26. SOCKS
 27. SOCKS
 28. SOCKS
 29. SOCKS
 30. SOCKS
 31. SOCKS
 32. SOCKS
 33. SOCKS
 34. SOCKS
 35. SOCKS
 36. SOCKS
 37. SOCKS
 38. SOCKS
 39. SOCKS
 40. SOCKS
 41. SOCKS
 42. SOCKS
 43. SOCKS
 44. SOCKS
 45. SOCKS
 46. SOCKS
 47. SOCKS
 48. SOCKS
 49. SOCKS
 50. SOCKS
 51. SOCKS
 52. SOCKS
 53. SOCKS
 54. SOCKS
 55. SOCKS
 56. SOCKS
 57. SOCKS
 58. SOCKS
 59. SOCKS
 60. SOCKS
 61. SOCKS
 62. SOCKS
 63. SOCKS
 64. SOCKS
 65. SOCKS
 66. SOCKS
 67. SOCKS
 68. SOCKS
 69. SOCKS
 70. SOCKS
 71. SOCKS
 72. SOCKS
 73. SOCKS
 74. SOCKS
 75. SOCKS
 76. SOCKS
 77. SOCKS
 78. SOCKS
 79. SOCKS
 80. SOCKS
 81. SOCKS
 82. SOCKS
 83. SOCKS
 84. SOCKS
 85. SOCKS
 86. SOCKS
 87. SOCKS
 88. SOCKS
 89. SOCKS
 90. SOCKS
 91. SOCKS
 92. SOCKS
 93. SOCKS
 94. SOCKS
 95. SOCKS
 96. SOCKS
 97. SOCKS
 98. SOCKS
 99. SOCKS
 100. SOCKS


Manufacturing or Installation Support By:
Silt Sock
 EROSION CONTROL PRODUCTS
 info@siltsock.net
 608-438-7625

EROSION & SEDIMENT CONTROL NOTES:

- PRIOR TO THE START OF CONSTRUCTION, HAYBALES, SILT FENCING AND ALL OTHER SPECIFIED EROSION CONTROL SHALL BE IN PLACE.
- THE CONTRACTOR SHALL BE REQUIRED TO ESTABLISH AND FULLY MAINTAIN ALL REQUIRED EROSION & SEDIMENT CONTROLS.
- ALL EXPOSED SLOPES, INCLUDING STOCKPILES OF MATERIAL SHALL RECEIVE TEMPORARY SEDIMENT & EROSION CONTROLS. THIS WILL INCLUDE LOAMING AND SEEDING, MULCHING, HAYMATS, ETC. TO STABILIZE THE AREA.
- ALL DRAINAGE STRUCTURE SHALL BE SURROUNDED BY HAYBALES TO PREVENT INFILTRATION OF SEDIMENTS.
- SHOULD SEDIMENT ENTER A CRITICAL AREA, (WETLAND, BUFFER ZONE, ABUTTING PROPERTY) THE CONTRACTOR SHALL IMMEDIATELY CLEAN AND RESTORE EFFECTED AREA.
- REFERENCE IS HEREBY MADE TO THE RHODE ISLAND SOIL EROSION AND SEDIMENT CONTROL HANDBOOK, PUBLISHED BY THE SOIL CONSERVATION SERVICE. THE GUIDELINES SHOWN THEREON SHOULD BE INCORPORATED INTO THE CONSTRUCTION PRACTICES ON SITE.
- UNDERGROUND UTILITIES ARE APPROXIMATE ONLY. THE CONTRACTOR SHALL VERIFY THEIR LOCATION THROUGH DIG-SAFE.

PLANT SCHEDULE

SYMBOL	COMMON NAME	BOTANICAL NAME
[Symbol]	BUSHY BLUESTEM	(ANDROPOGON GLOMERATUS)
[Symbol]	SWAMP AZALEA	(RHODODENDRON VISCOSUM)
[Symbol]	LILAC	(SYRINGA VULGARIS)
[Symbol]	ARROWWOOD	(VIBERNUM DENTANUM)

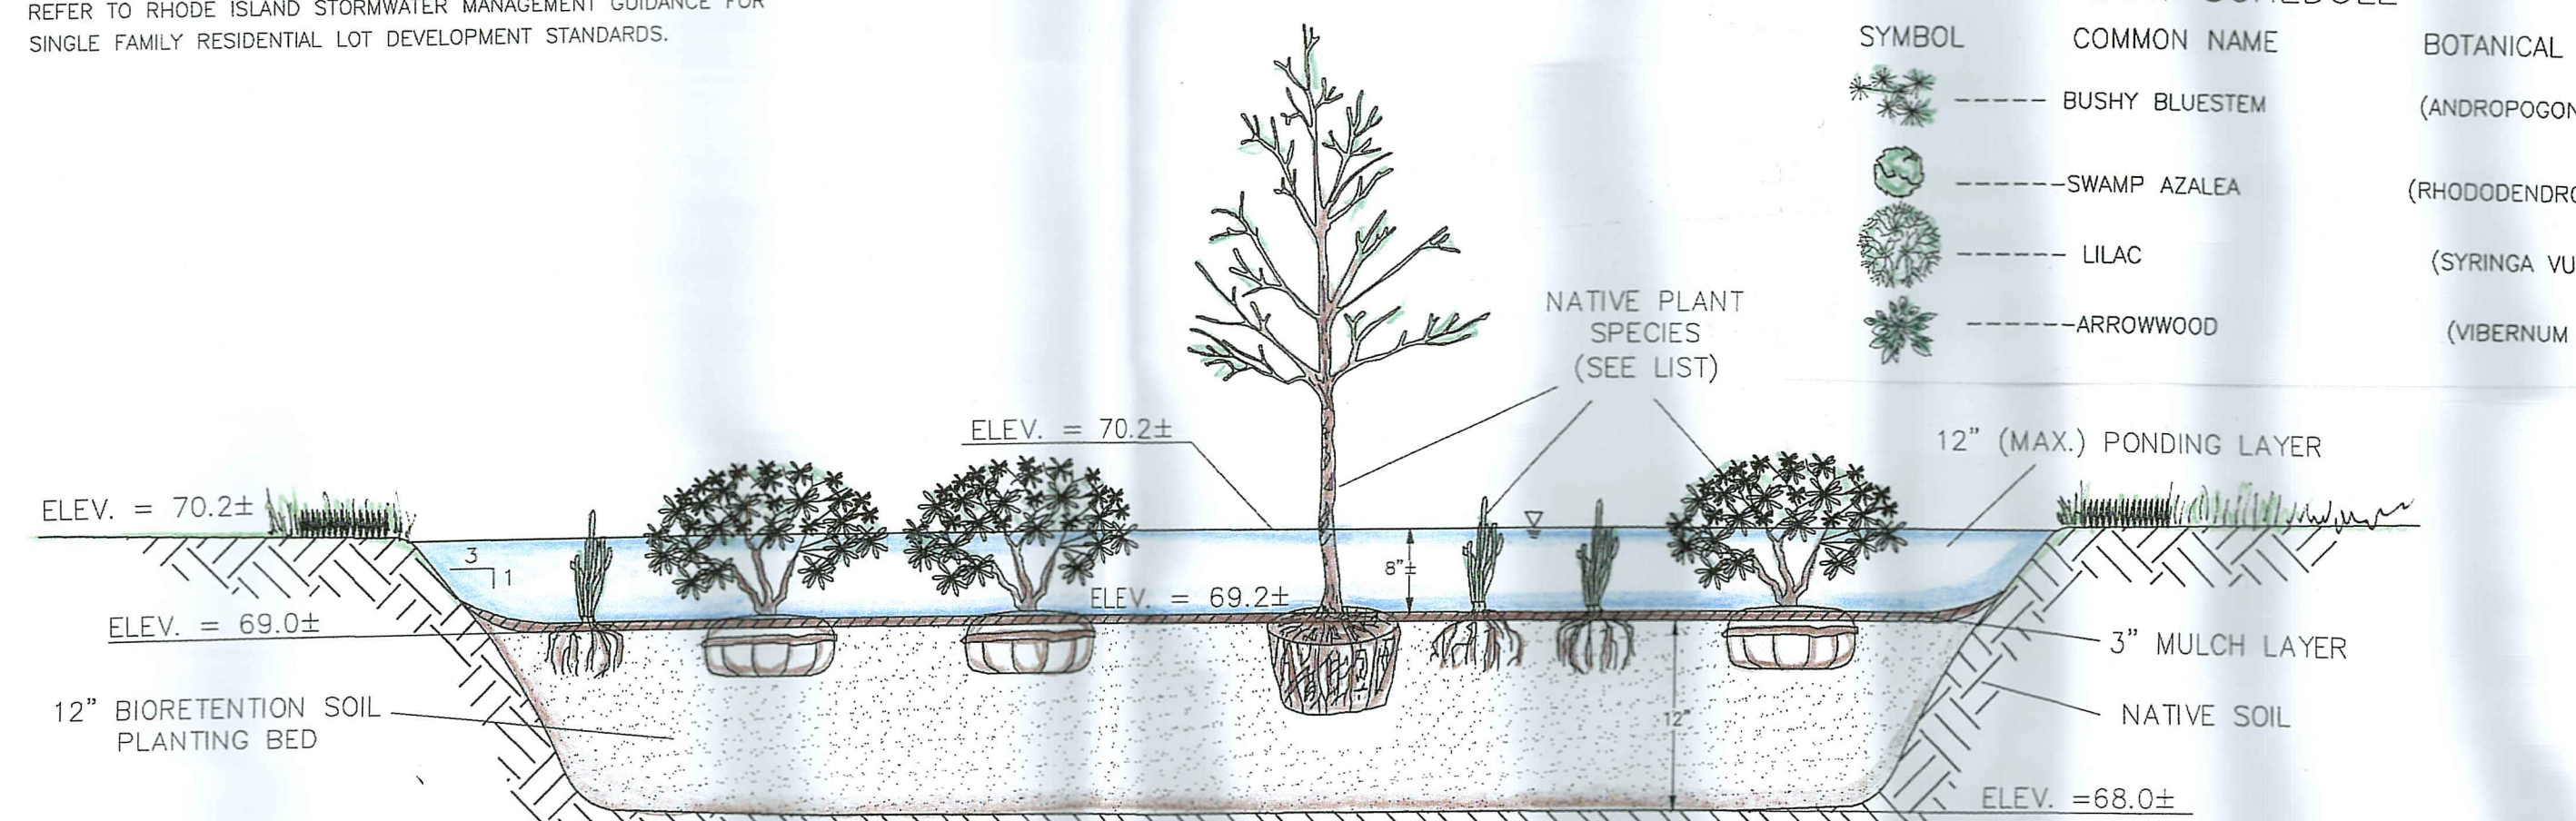

BIORETENTION/RAINGARDEN AREA - TYPICAL CROSS-SECTION
 NOT TO SCALE

REFER TO RHODE ISLAND STORMWATER MANAGEMENT GUIDANCE FOR SINGLE FAMILY RESIDENTIAL LOT DEVELOPMENT STANDARDS.


CONSTRUCTION ACCESS ROAD DETAIL

MATERIAL SIZE	
SQUARE MESH SIEVES	RIDOT 2" CRUSHED STONE
2-1/4 INCHES	100
2 INCHES	90 - 100
1-1/2 INCHES	30 - 55
1-1/4 INCHES	0 - 25
1 INCH	0 - 5

NOTES:
 1. SHALL BE IN ACCORDANCE WITH SECTION 211 OF THE R.I. STANDARD SPECIFICATIONS.
 2. CRUSHED STONE SHALL CONFORM TO THE REQUIREMENTS OF M.01.09 OF THE R.I. STANDARD SPECIFICATIONS.
 3. LENGTH SHALL BE 50 FT MINIMUM IN SAND AND GRAVEL AREAS OR 100 FT MINIMUM IN SILT AND CLAY AREAS. LENGTH MAY BE REDUCED IF TRAVEL LENGTH IS LESS.


PLANT SCHEDULE

SYMBOL	COMMON NAME	BOTANICAL NAME	QUANTITY
[Symbol]	WHITE PINE	(Pinus strobus)	(2) Minimum
[Symbol]	RED MAPLE	(Acer Rubrum)	No Minimum
[Symbol]	OAKS	(Quercus spp)	No Minimum
[Symbol]	HOLLY	(Ilex Opaca)	(2) Minimum
[Symbol]	SPRUCE	(Picea spp)	No Minimum
[Symbol]	GRAY BIRCH	(Betula Populifolia)	No Minimum
[Symbol]	MOUNTAIN LAUREL	(Kalmia latifolia)	No Minimum
[Symbol]	ARROWWOOD	(Viburnum dentatum)	No Minimum
[Symbol]	WINTERBERRY	(Ilex verticillata)	(4) Minimum
[Symbol]	INKBERRY	(Ilex glabra)	No Minimum
[Symbol]	SPICE BUSH	(Lindera benzoin)	No Minimum
[Symbol]	SWEET PEPPERBUSH	(Clethra alnifolia)	No Minimum
[Symbol]	HIGHBUSH BLUEBERRY	(Vaccinium corymbosum)	(4) Minimum
[Symbol]	SWAMP AZALEA	(Rhododendron viscosum)	No Minimum
[Symbol]	ALDER	(Alnus spp)	No Minimum
[Symbol]	Buttonbush	(Cephalanthus occidentalis)	No Minimum

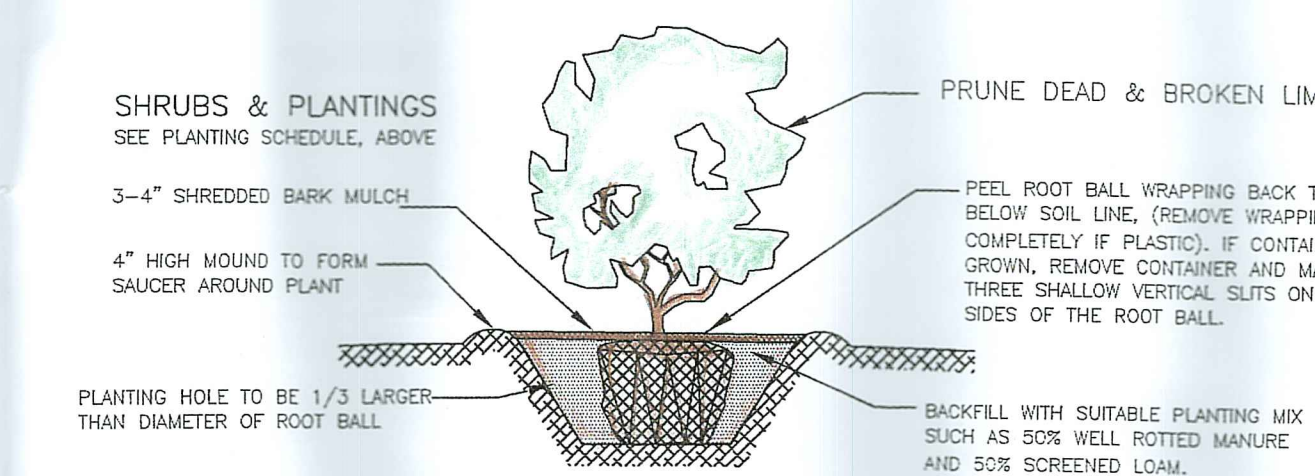

SHRUB PLANTING DETAIL
 NOT TO SCALE

- ### PLANTING NOTES:
- THE SHRUBS ARE TO BE PLANTED IN MASSES OF 3min. AND TO BE SPACED 4'+ ON CENTER.
 - THE PLANTS ARE TO BE PLANTED AS SPECIFIED IN THE PLANTING DETAIL. ADEQUATE WATER IS TO BE SUPPLIED IN ORDER TO ESTABLISH HEALTHY AND VIGOROUS PLANTS.
 - ANY PLANT WHICH IS UNHEALTHY OR DEAD AFTER ONE YEAR SHALL BE REPLANTED.
 - SELECT NATIVE PLANTS FOR RAIN GARDEN USING THE "COASTAL PLANT GUIDE" (www.uri.edu/cels/ceoc/coastalPlants/CoastalPlantGuide.htm)

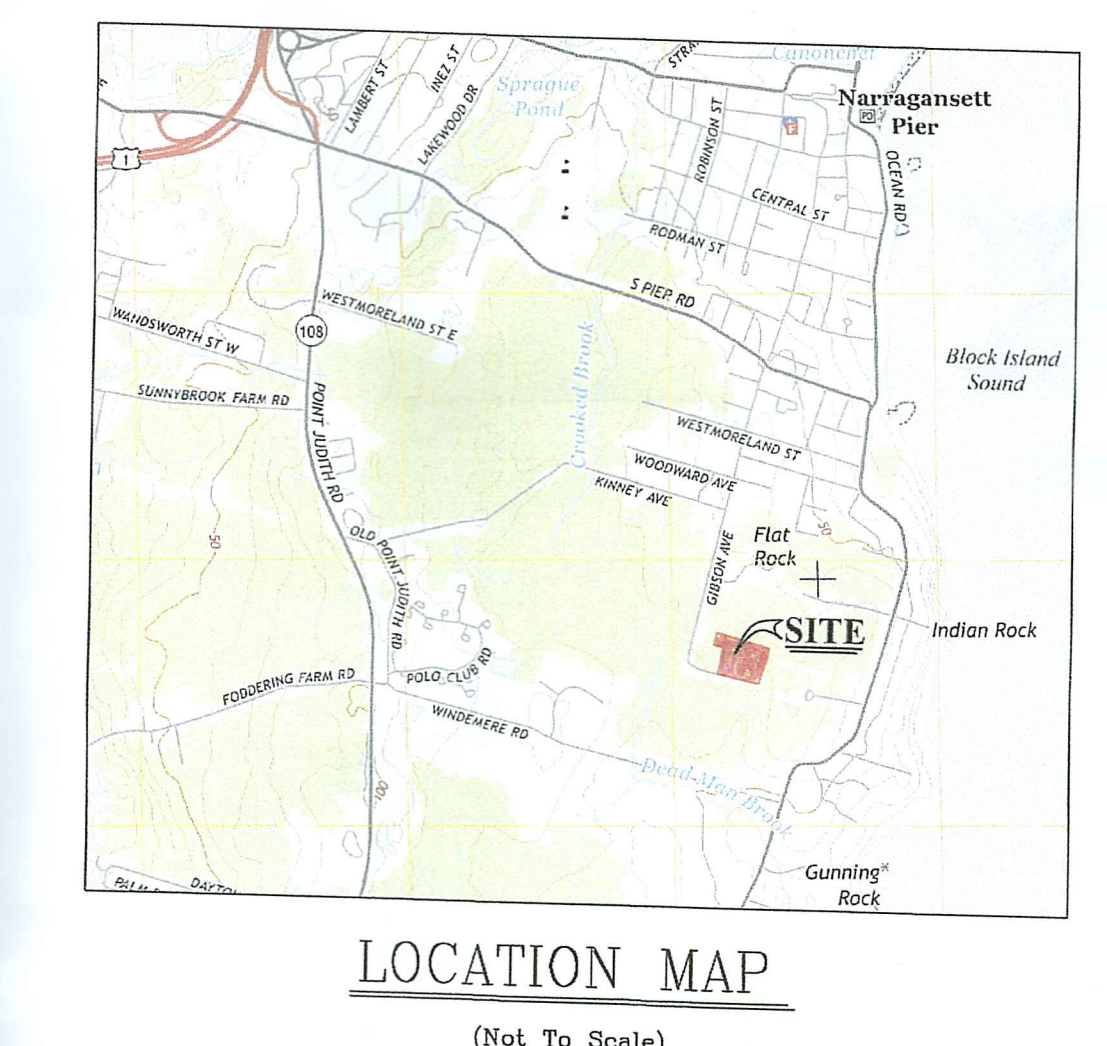

STORMWATER MANAGEMENT & EROSION CONTROL DETAILS & NOTES FOR NEW DWELLING & SEPTIC DESIGN FOR LAND BELONGING TO
MICHAEL G. MCCARTHY LIVING TRUST
 LAND SITUATED AT THE END OF GIBSON AVENUE ON ASSESSOR'S PLAT "Z" / LOT 2
 SITUATED IN THE TOWN OF NARRAGANSETT, RHODE ISLAND
 DATE: SEPT. 12, 2022; SCALE: NOTED
 REVISED: NOV. 30, 2022; PER RIDEM-FWW & O.W.T.S. REVIEWS
 PREPARED BY:
EASTERBROOKS & ASSOCIATES, LLC.
 2505 BOSTON NECK ROAD SAUNDERSTOWN, R.I. 02874 TEL.401.667-7770
 SHEET 2 of 2.